


VIVIDAIR™
ANYTHING ELSE IS STALE



Z-TECH™ FAN

INSTALLATION AND TECHNICAL OPERATIONS GUIDE

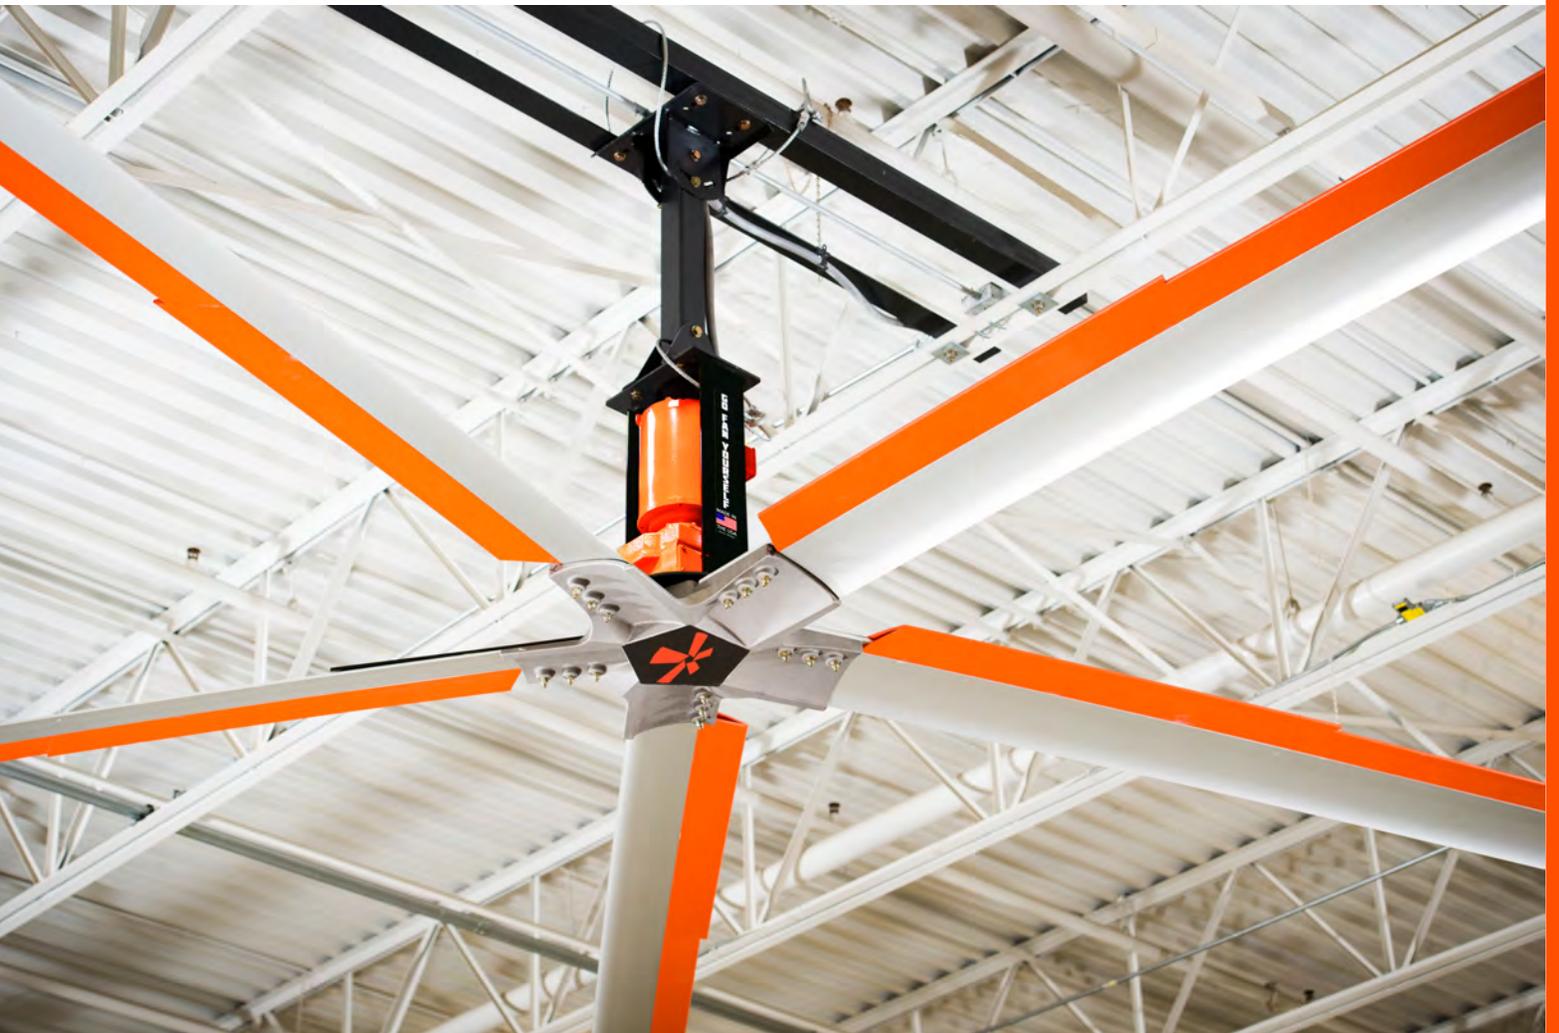



INSTALLATION CHECK IN / CHECK OUT

Email completed form and required pictures to: drew@gofanyourself.com

Company: _____
Address: City/ _____
State/Zip: _____ Contact Name: _____
Email: _____ Phone: _____

INSTALLATION CHECK IN

Installation crew supervisor and facility manager are to complete checklist prior to entering the jobsite or unloading materials.

- Contractor and customer have reviewed the scope of work/layout including: fan placement, controller placement, and power supply panel(s) to be used.
- Contractor and customer have reviewed the fan installation manual for the type of fan mount at each location.
- Contractor and customer have reviewed the installation schedule and any site specific safety rules and regulations (i.e., specific requirements, gear, certifications, lock out/tag out, prohibited areas, secure areas, areas to avoid, special machinery, dangerous conditions or areas and how to detour such places if needed):

Additional Comments: _____

Customer Signature: _____	Contractor Signature: _____
Printed Name: _____	Printed Name: _____
Date: _____	Date: _____

INSTALLATION CHECK OUT

Installation crew supervisor and facility manager are to complete checklist after completing installation.

- Fan and controller placement agrees with the check in (above), scope of work and layout.
- Contractor has reviewed with the customer the breaker location for all fans and the customer understands the lock out/tag out (LOTO) procedure on all fan controllers.
- No safety incidents were reported by or on the contractor during the fan installation.
- All fans are running and the customer has been trained on operation in both directions. The fan operation section of the manual has been reviewed.
- The customer understands the warranty for each fan and the warranty information in the manual has been reviewed.
- The customer has been given a copy of the installation manual for all styles of GFY[®] fans installed as part of this project.
- The customer is comfortable with fan operation including starting/stopping, speed adjustment, reversing direction, and power disconnect with LOTO.
- The contractor has taken pictures of all fans individually clearing showing the full fan in the ceiling (required to activate the warranty).
- The contractor has taken pictures of all fans clearly showing the routing and connection of both safety cables (required to activate the warranty).
- The contractor has taken pictures of all fan controllers once mounted in their final locations (required to activate the warranty).

Customer Signature: _____	Contractor Signature: _____
Printed Name: _____	Printed Name: _____
Date: _____	Date: _____

Itemized Checklist - Unpacking Your Go Fan Yourself Fan

Motor Hub Assembly Box

- There are 3 trays inside the Motor Hub Assembly Box
(Trays Detailed On Following Pages)
- The Blade Stabilizers are also inside the motor box.



Blade Box Skid



Down Tubes 3FT and Longer May Also Be Packaged and Shipped On The Blade Box Skid

Itemized Checklist - Motor Assembly Box Tray #1 - Top Tray

Down Tube

1FT or 2FT Down Tubes Only. Longer Down Tubes will Be Packaged Separately

Upper Yoke Weldment & Beam Clamp Plates



ACS355 or ACS255 VFD Controller

ACS255 Controller Shown


Accessory Area

Typical Items Packed Here Will Include:

- Z-Purlin Mounting Kit
- Wood Beam Mounting Kit
- Guy Wire Kit


Your Fan May Include Other Optional Accessories

Itemized Checklist - Motor Assembly Box Tray #2 - Middle Tray

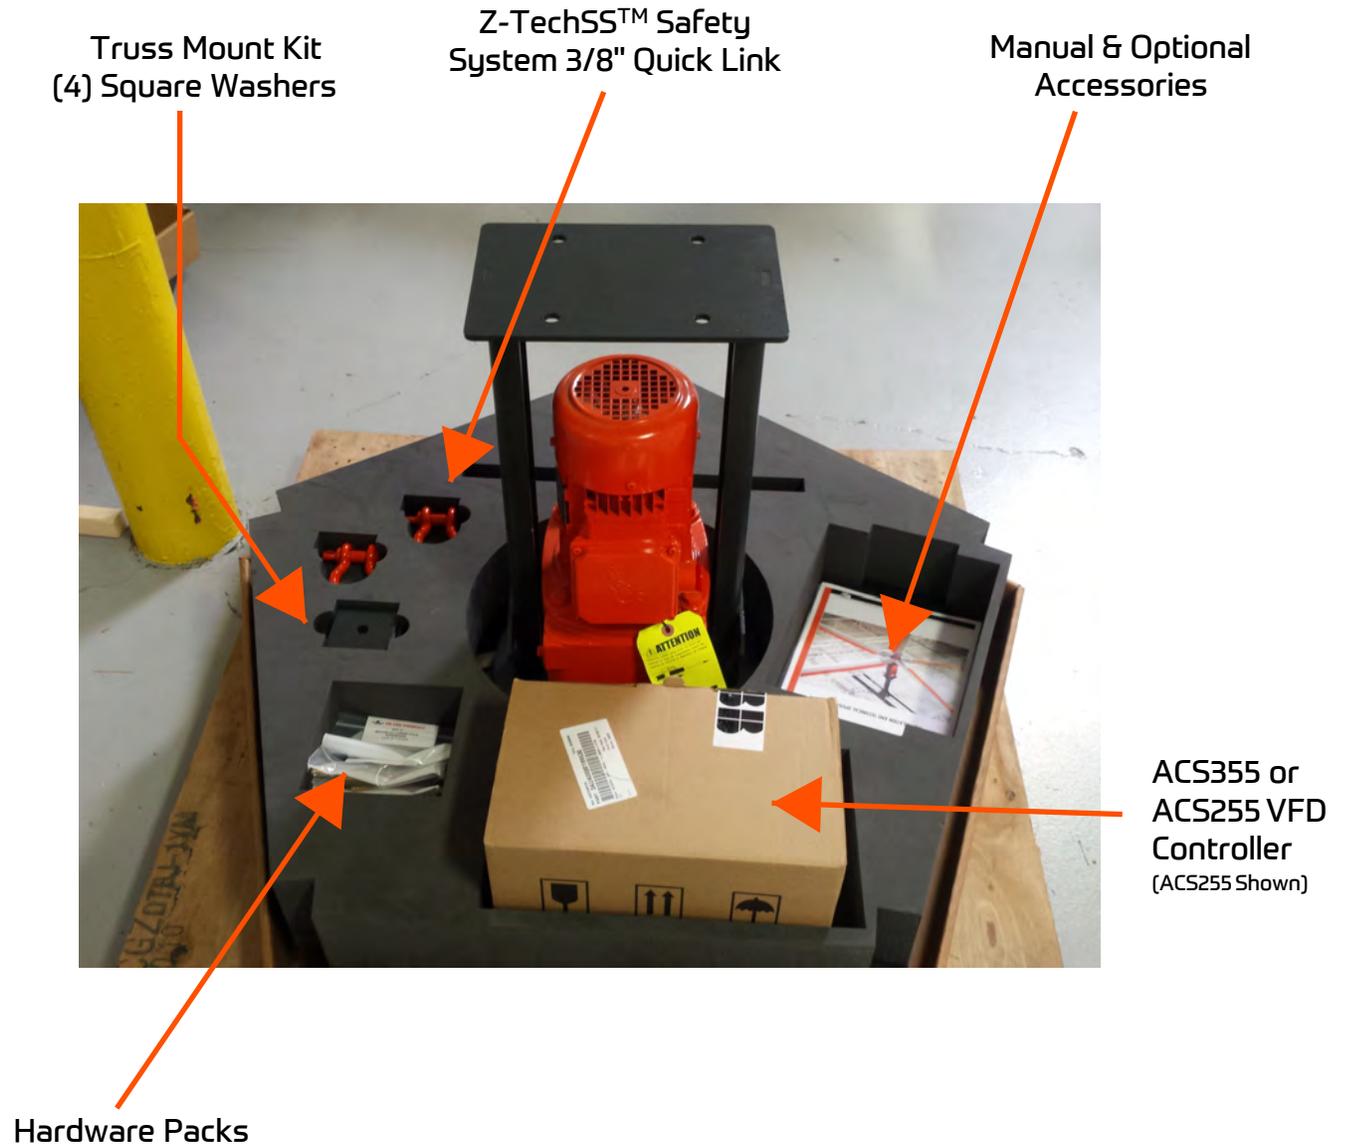

Itemized Checklist - Motor Assembly Box Tray #3 - Bottom Tray

Motor Hub Assembly

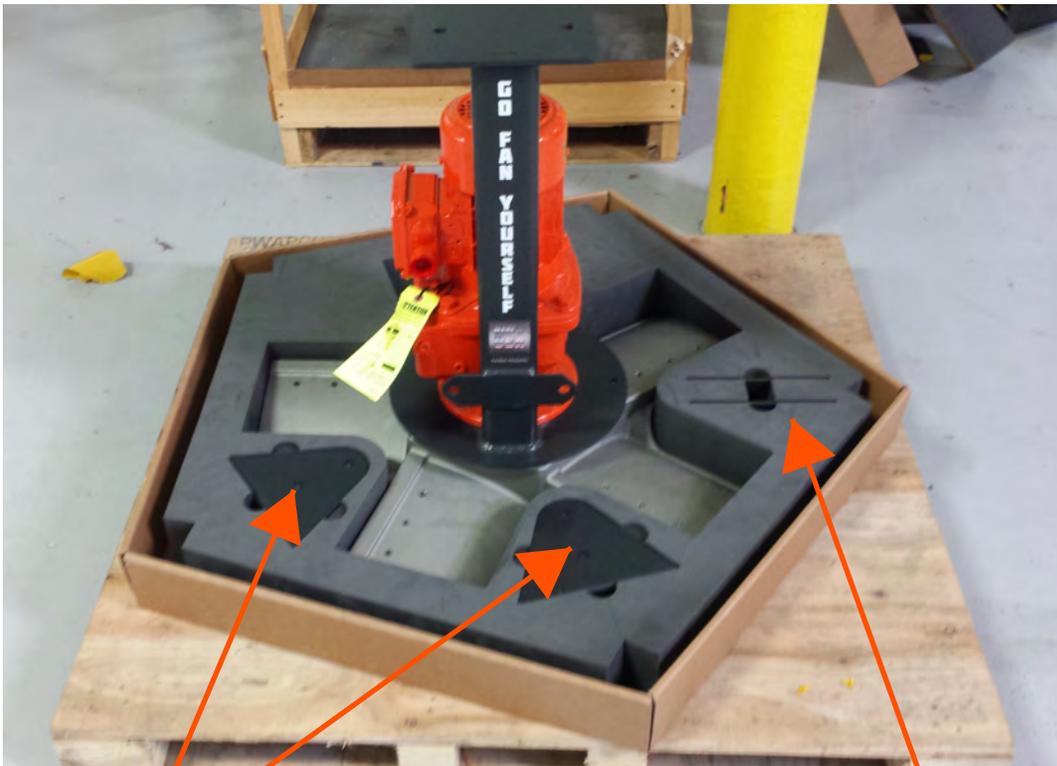

Lower Yoke Plates

Fan Mount Shims

To Keep The Beam Clamp Plates Near Level When Clamping To Thicker I-Beams. Add Additional Shims If Required.

Itemized Checklist - ABB VFD Controllers, Blade Box, Blade Stabilizer Box

ABB ACS355 Controller
200-240VAC 3 Phase
400-480VAC 3 Phase
Applications



ABB ACS255 Controller
200-240VAC 1 Phase
100-120VAC 1 Phase
Applications



Itemized Checklist - Fan Blade Box

Blade Set (5 Blades) 8ft, 10ft, 12ft, 14ft, 16ft, 18ft, 20ft, 22ft, or 24ft



Z-TECH™ FAN

Installation and Technical Operations


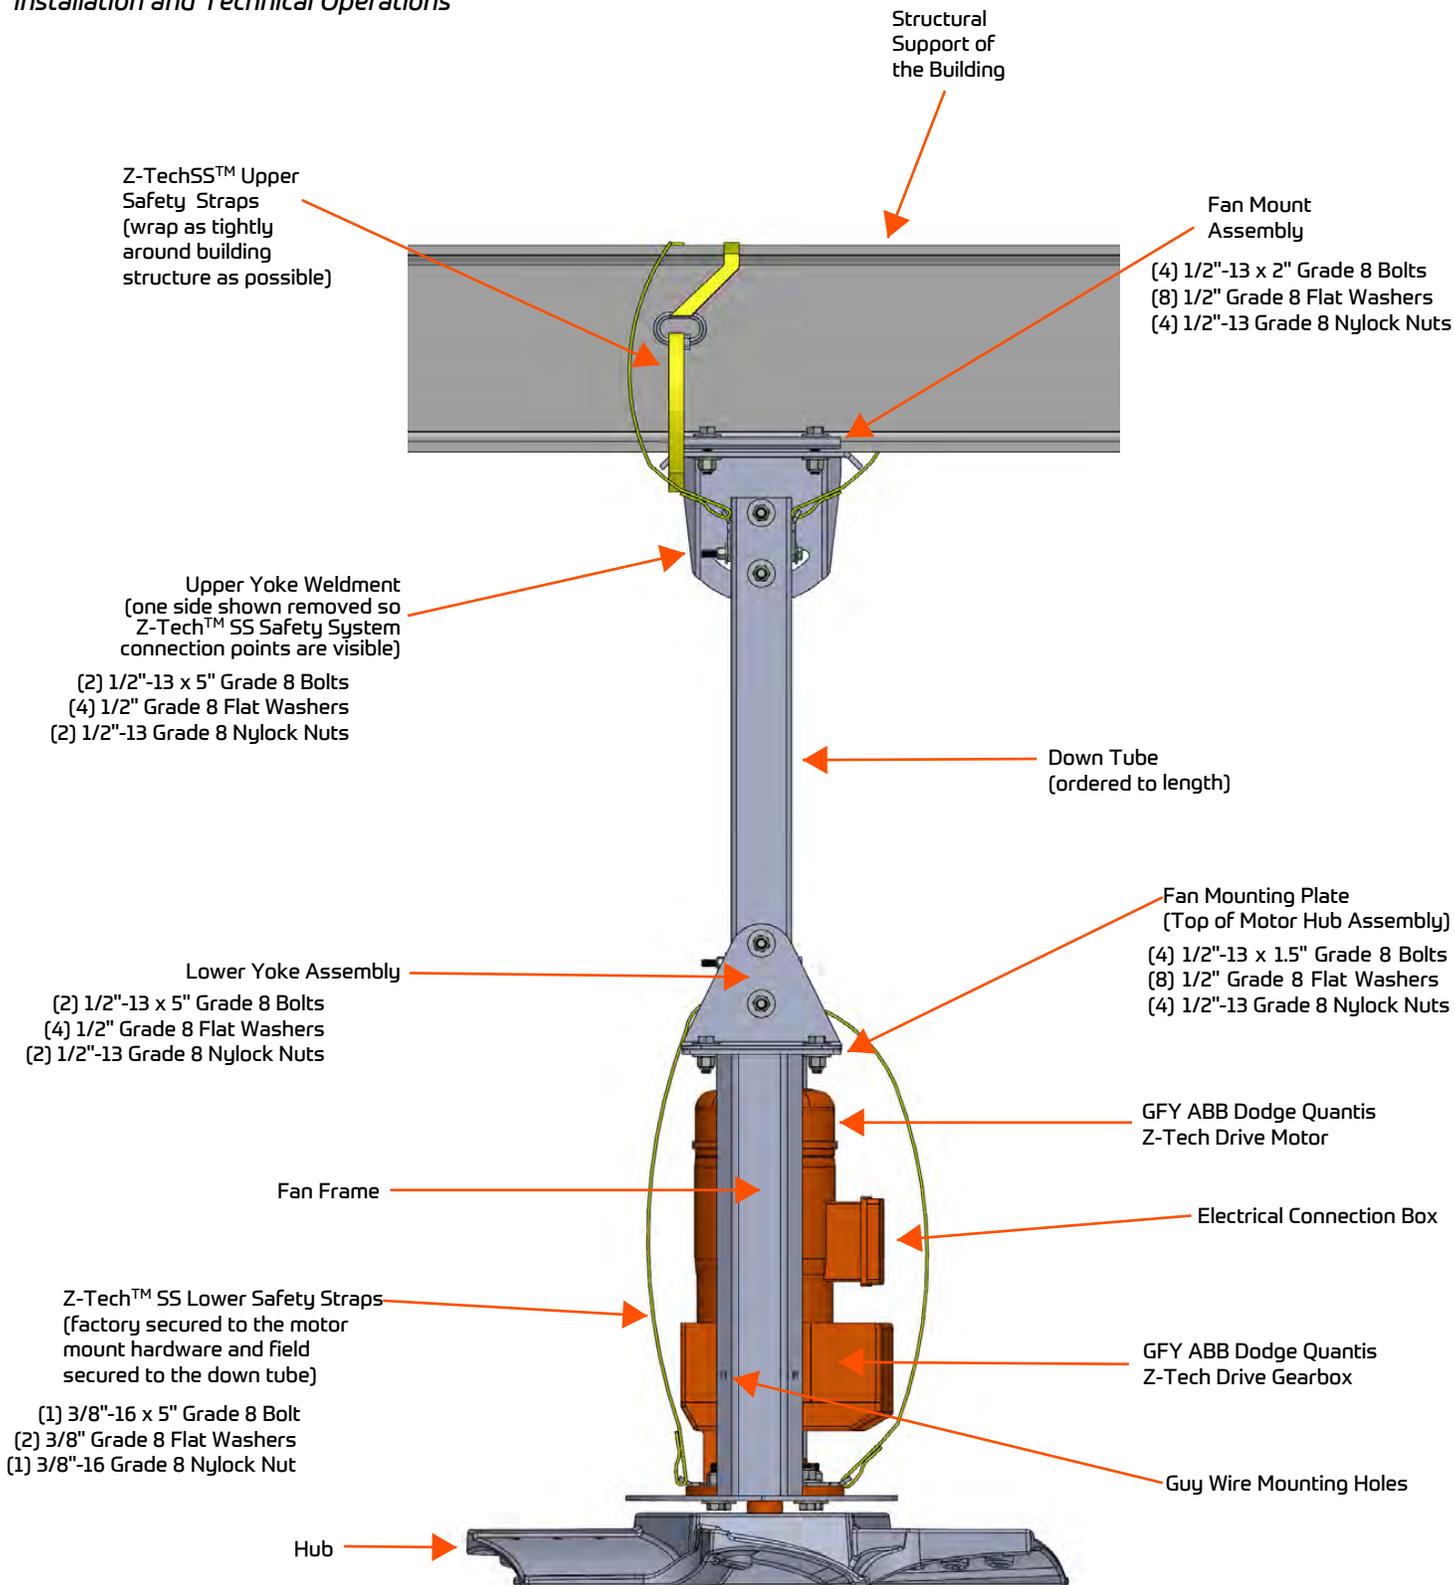


Table of Contents

	Locate Your GFY® Fan (Recommended Clearances)	09
1.	Tools Required to Install Product	10
2.	Required Steps Before Installation	11
3.	Different Mounting Applications	11
	"1" Beam Mounting Fig.2	11
	Bottom Chord Angle Iron Mount Fig.3	11
	Top Chord Angle Iron Mount Fig.4	12
	"L - Bracket" Mounting Fig. 5	13
	"Z - Purlin" Mounting Fig. 6	14
4.	Standard Mount	15
	What is included in the mount package	15
	What standard mounts are available Fig.7	15
	How to install the standard mount Fig.8	15
5.	Down Tube	16
	What is included in the down tube package	16
	How to install the down tube, upper safety cable, and lower yoke assembly	16
	Typical safety cable routing Fig. 11	16
6.	Main Hub and Drive Assembly	17
	What is included in the main hub and drive assembly Fig. 12	17
	How to install the assembly Fig. 13	17
	Installing the lower safety cable (Reference Fig. 11 page #11)	17
7.	Guy Wires	18
	What is included in the guy wires:	18
	How to install the guy wires:	
	Fig. 14	18
	Fig. 15	18
	Fig. 16	18
	Fig. 17	19
8.	Blade Assembly	19
	What is included with the blades	19
	How to install the blades Fig. 18	19
9.	Leveling the fan & Removing the Oil Vent Plug on the Motor	20
	Fig.19	20
10.	Electrical Installation	21
	Safety Precautions	21
	Wire Requirements	22
	Maximum Power Cable Length	23
	Power Requirements	24
	Wire Locations & VFD Connections	25
	ESFR Wire Connections	26-27
	Wire Connections (Motor)	28-28A
	Operation Instructions for the VFD (3 phase & 1 phase applications)	29-30
	Fan Operation Best Practices	31
	Maintenance Schedule / Safety Precautions	32
	Clearance Requirements	33
	GFY Annual Performance Plan	34
	Recommended Maintenance Checklist	35
	Troubleshooting Guides	36-42
	Warranties and Liabilities	43-46

Recommended GFY® Fan Clearances

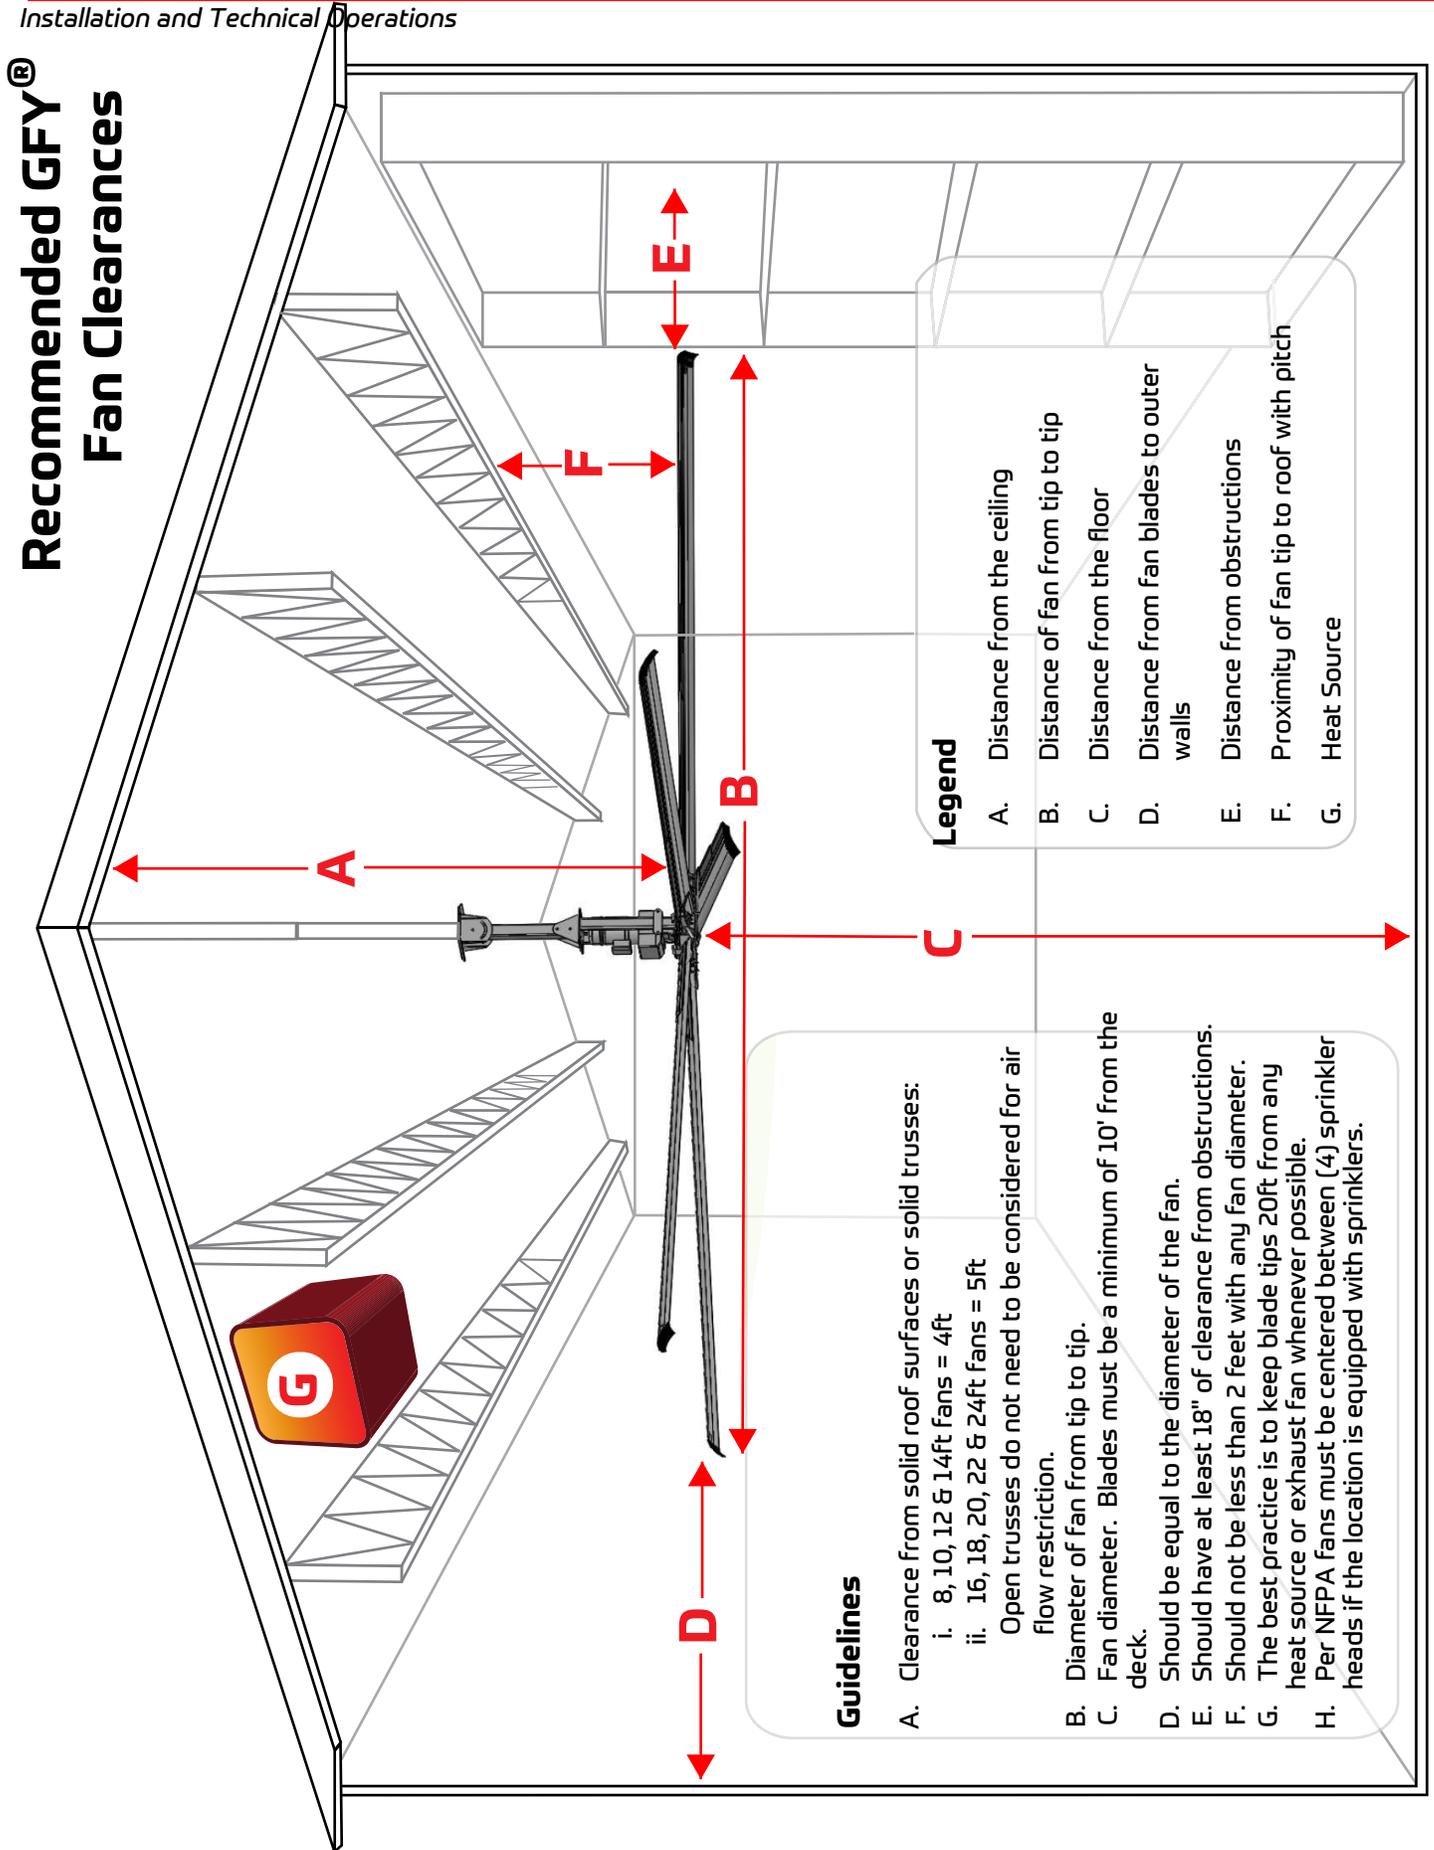

Legend

- A. Distance from the ceiling
- B. Distance of fan from tip to tip
- C. Distance from the floor
- D. Distance from fan blades to outer walls
- E. Distance from obstructions
- F. Proximity of fan tip to roof with pitch
- G. Heat Source

Guidelines

- A. Clearance from solid roof surfaces or solid trusses:
 - i. 8, 10, 12 & 14ft fans = 4ft
 - ii. 16, 18, 20, 22 & 24ft fans = 5ft
 Open trusses do not need to be considered for air flow restriction.
- B. Diameter of fan from tip to tip.
- C. Fan diameter. Blades must be a minimum of 10' from the deck.
- D. Should be equal to the diameter of the fan.
- E. Should have at least 18" of clearance from obstructions.
- F. Should not be less than 2 feet with any fan diameter.
- G. The best practice is to keep blade tips 20ft from any heat source or exhaust fan whenever possible.
- H. Per NFPA fans must be centered between (4) sprinkler heads if the location is equipped with sprinklers.

Follow the Factory Mutual Insurance Company (FM Global) standards, Heating equipment manufacturer's guideline and safety standards such as those published by the National Fire Protection Association (NFPA), and the American Society for Heating, Refrigeration and Air Conditioning Engineers (ASHRAE), and local code authorities.

WARNING: A structural engineer will need to verify that the structure is suitable prior to the installation of the fan. The fan should not be installed unless the structure on which the fan will be mounted is securely constructed, without damages, and can support the load of the fan. It is the sole responsibility of the customer/end user to have the stability of the mounting structure verified. Go Fan Yourself® hereby denies any liability resulting from the lack of verification or from the use of any materials or hardware than those supplied by Go Fan Yourself® or otherwise indicated within these installation instructions.

1. Tools Required to Install Product

- Level
- High torque 1/2" impact gun with impact socket set
- Torque wrench capable of 30 ft-lbs +/- 2 ft-lbs
- Standard socket set
- Standard wrench set
- Scissor or Boom Lift

2. Required Steps Before Installation

- Check to see if you have all the tools required for the installation.
- Verify that all fan components were received.
- Check drawings and layouts provided to locate where the Z-Tech™ Fan is to be installed.
- Each person installing the Z-Tech™ Fan must use a safety harness at all times.
- Other safety requirements may be required for installation.
- All workspace safety requirements and lock out/tag out procedures provided by the customer for the assembly and installation of the Z-Tech™ Fan must be met and followed.

Start your installation

"I" Beam Mounting



Fig.2

3. Different Mounting Applications

Note: The following mounting applications are representations only and are subject to change without notice. Contact your sales representative or the Go Fan Yourself® office for complete mounting instructions.




Insert optional shims (found in bottom tray of your fan packaging) to keep Beam Clamp Plates near level if I-Beam is thicker than the bend in the Beam Clamp Plate. Shims insert on top of the Upper Yoke Assembly and are secured with the mounting hardware. See picture above and following pages for additional details.

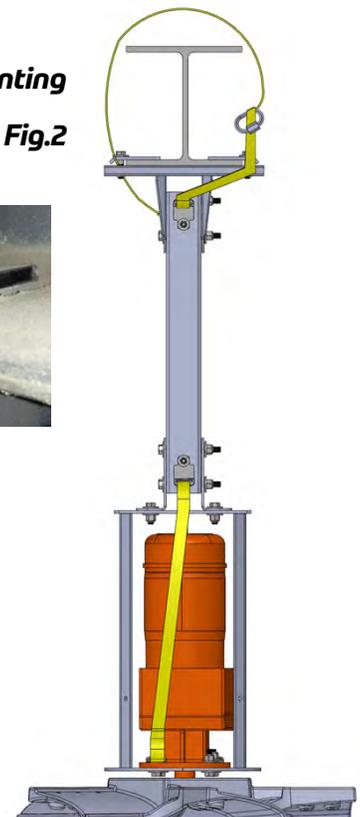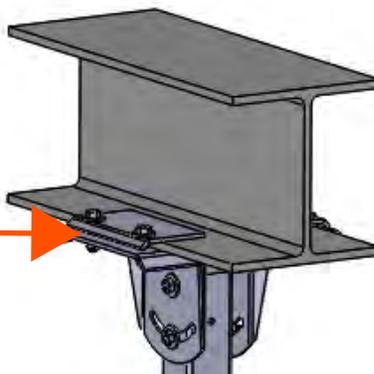

3. Different Mounting Applications

Bottom Chord Angle Iron Mount
 Drill holes in angle iron and direct mount in place of using Beam Clamp Plates.

Fig.3

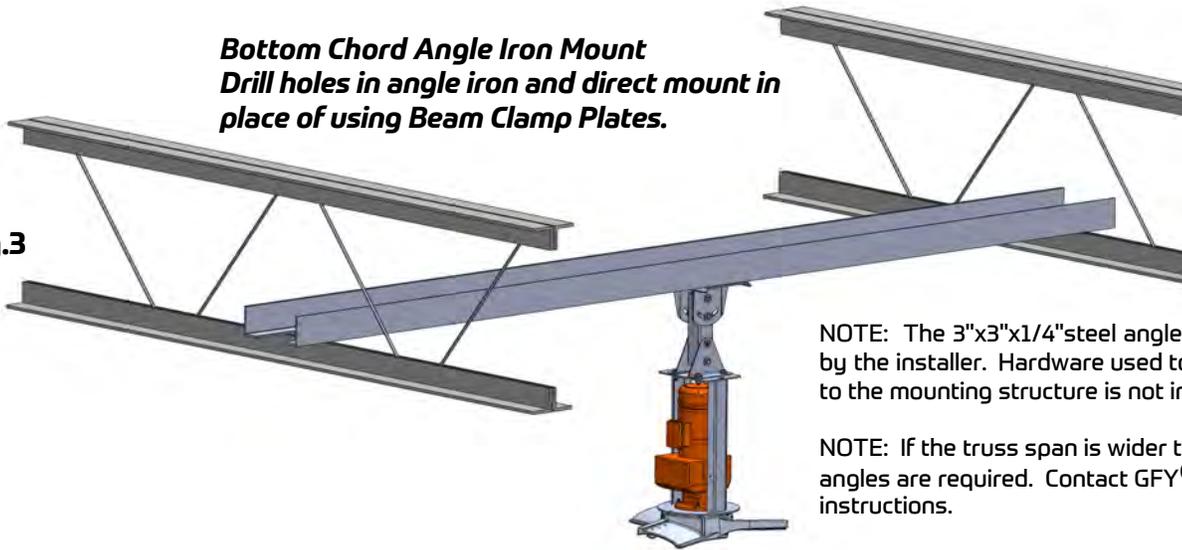


NOTE: The 3"x3"x1/4" steel angles must be supplied by the installer. Hardware used to secure the angles to the mounting structure is not included.

NOTE: If the truss span is wider than 8 FT (4) steel angles are required. Contact GFY® for additional instructions.

*****NOTE*** Hardware A, B, and C below are contractor supplied.**

- A - (4) 1/2"x13x1.5" longer than the lower chord of the truss Grade 8 Cap Head Screw
- B - (8) 1/2" Grade 8 Flat Washer
- C - (4) 1/2"x13 Grade 8 Steel Nylock Nut
- D - (1) GFY® Truss Mount Kit will be included with your fan (kit consists of (4) large square washers). Tighten all hardware to a minimum of 40 Ft lbs (54.2 N.m).

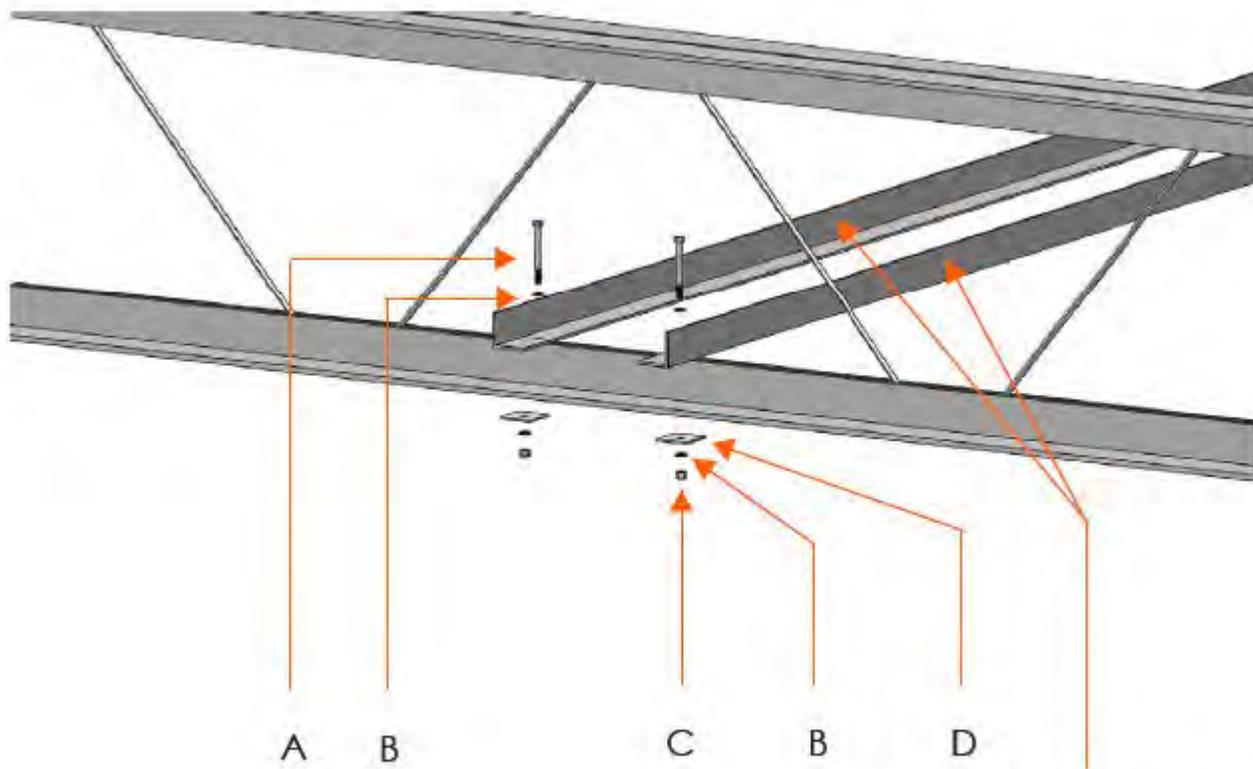


3"x3"x1/4" steel angles

- Face angle irons as shown.
- Once mounted use Upper Yoke Weldment and mark mounting holes on the angle irons.
- Drill (2) holes in each angle iron and direct mount the Upper Yoke Weldment to the angle irons.
- The Beam Clamp Plates and shims are not used in this application.

3. Different Mounting Applications (continued)

Top Chord Angle Iron Mount
Drill holes in angle iron and direct mount in place of using Beam Clamp Plates.

Fig.4

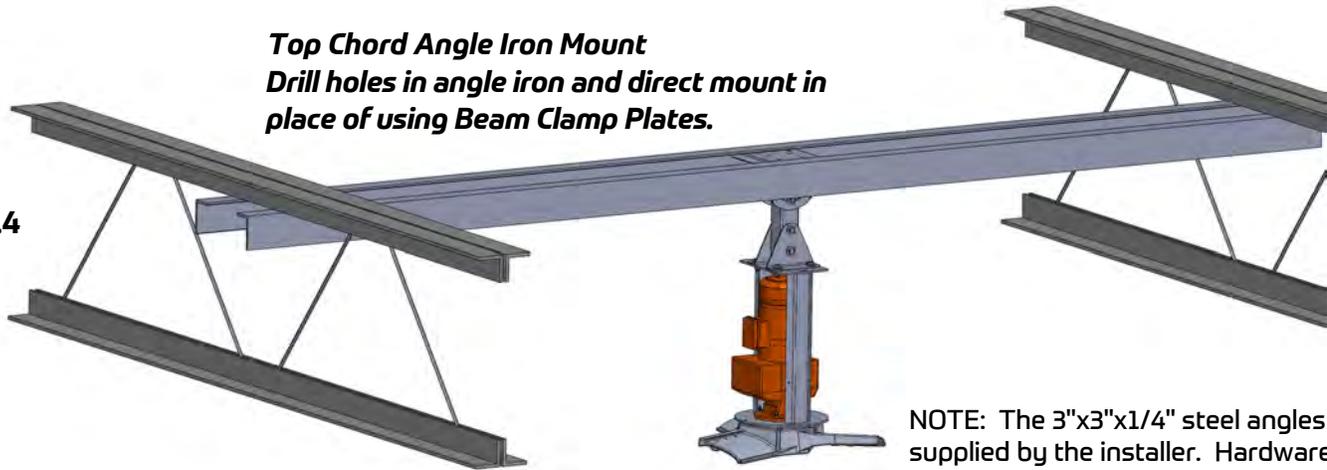


NOTE: The 3"x3"x1/4" steel angles must be supplied by the installer. Hardware used to secure the angles to the mounting structure is not included.

*****NOTE*** Hardware A, B, and C below are contractor supplied:**

- A - (4) 1/2"-13x(chord height + 1.5") Grade 8 Cap Head Screw
 - B - (8) 1/2" Grade 8 Flat Washer
 - C - (4) 1/2"-13 Grade 8 Steel Nylock Nut
 - D - (1) GFY® Truss Mount Kit will be included with your fan (kit consists of (4) large square washers).
- Tighten all hardware to a minimum 40 ft lbs (54.2 Nm).

NOTE: If the truss span is wider than 8' (4) steel angles are required. Contact GFY® for additional instructions.

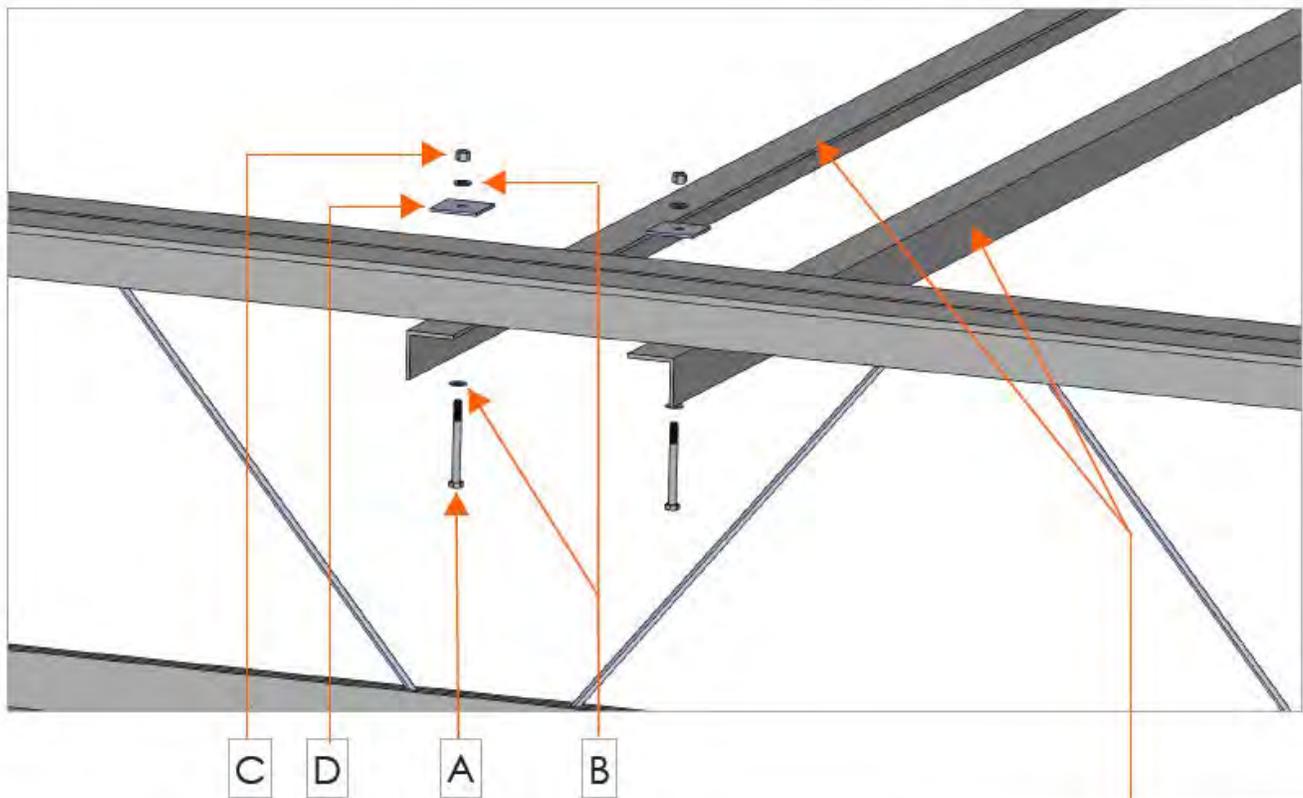

- Face angle irons as shown.
- Once mounted use Upper Yoke Weldment and mark mounting holes on the angle irons.
- Drill (2) holes in each angle iron and direct mount the Upper Yoke Weldment to the angle irons.
- The Beam Clamp Plates and shims are not used in this application.

3"x3"x1/4" steel angles

3. Different Mounting Applications *(continued)*

"L-Bracket" Mounting



(Refer to L-Bracket Installation Guide) Fig.5

Secure L-Brackets

As shown below secure the L-Brackets and Safety Clips with Carabiners to the mounting structure with installer-supplied:

Contractor Supplied Required Hardware:

- (2) 1/2"-13 x "1 1/2" longer than the support structure" Grade 8 Hex Cap Screw
- (4) 1/2" Grade 8 Flat Washer

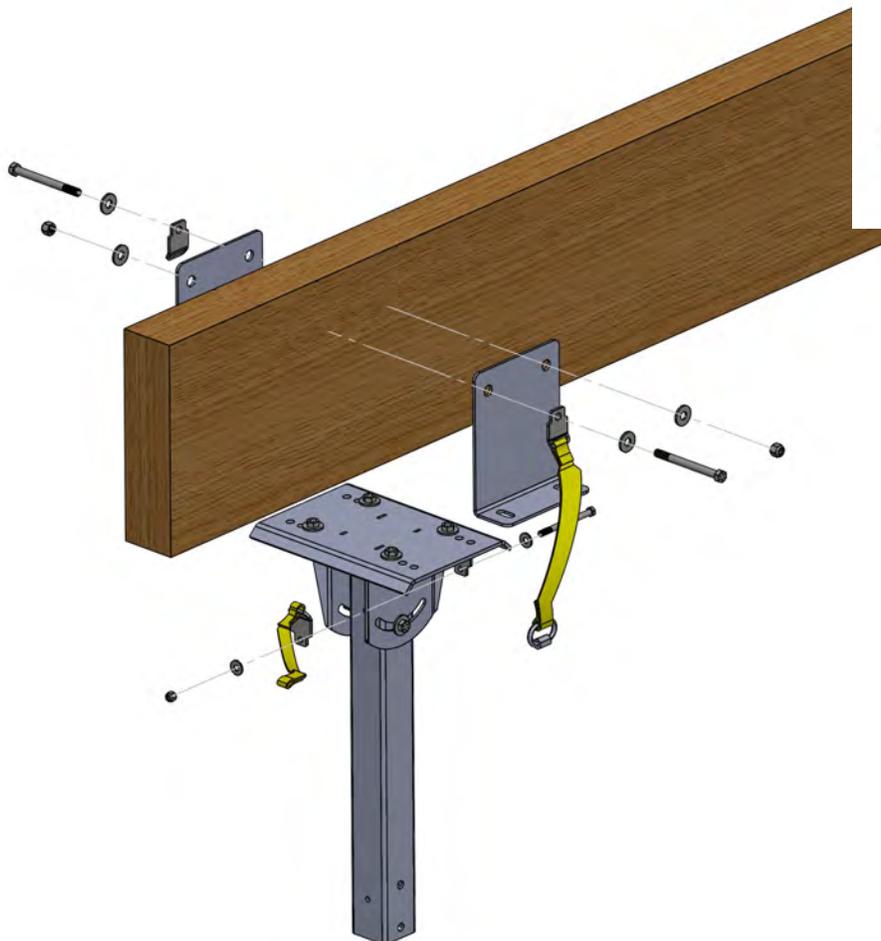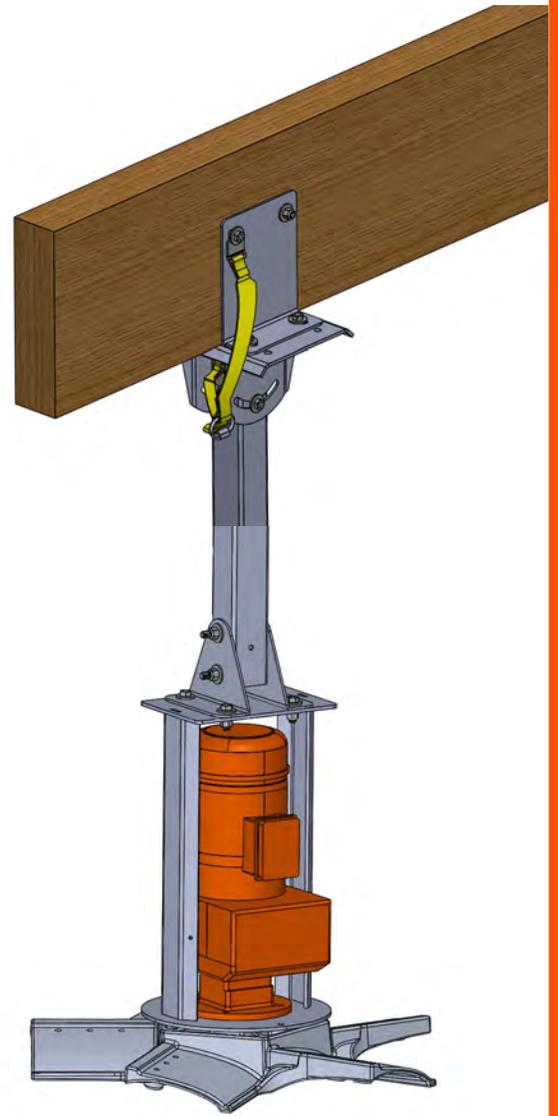

3. Different Mounting Applications *(continued)*



“Z-Purlin” Mounting

(Refer to Z-Purlin Installation Guide)

Fig.6


- 1) Drill the Z-Purlins using the backer plate as a template and anchor the backer plate to the Z-Purlin Bracket with supplied hardware. Tighten to a minimum 40 ft lbs (54.2 N·m).
- 2) Measure and pre-drill the angle irons for the fan mount using the mount as a template.
- 3) Finger tight the angle irons facing outward to hold them in place and attach the fan mount.
- 4) Tighten both the fan mount hardware and the angle iron hardware to a minimum 40 ft lbs (54.2 Nm).

NOTE: Z-Tech Fans equipped with Z-Chill must NOT mount to Z-Purlins with this kit. They must be mounted directly to the main beams and not on the Z-Purlins.

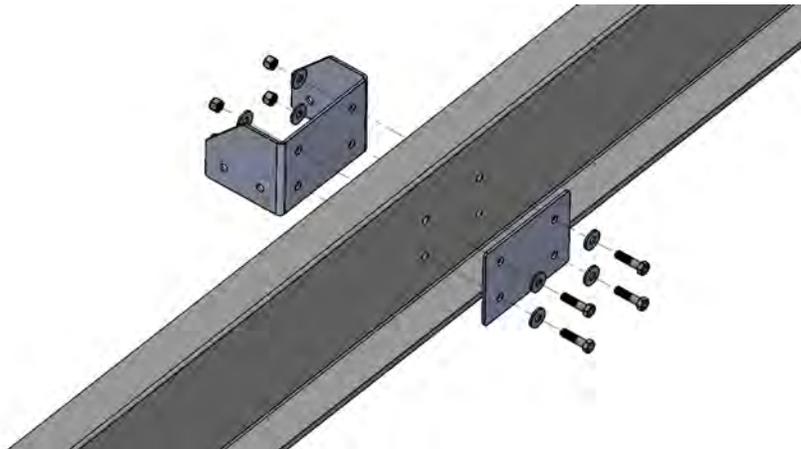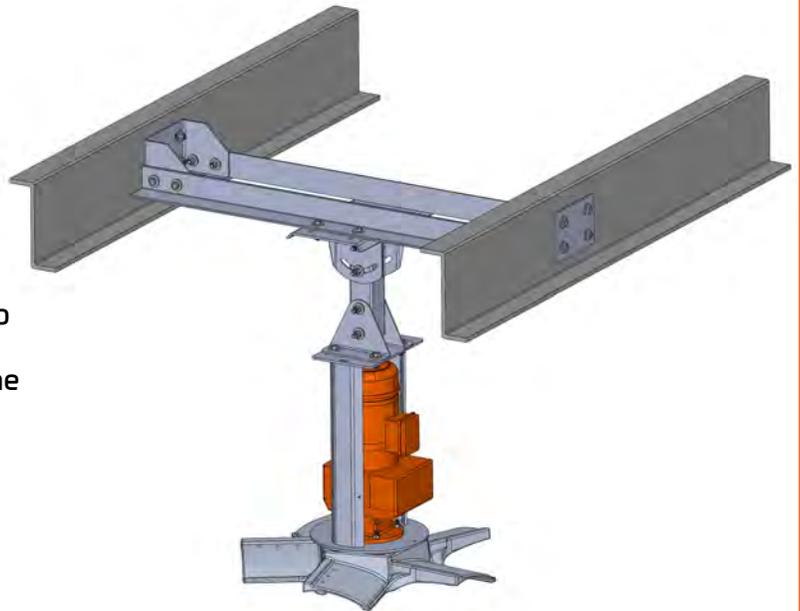

Mounting Hardware Supplied

- a. (16) 1/2"-13 x 2" Grade 8 Hex Head Cap Screw
 - b. (32) 1/2" Grade 8 Flat Washer
 - c. (16) 1/2" Grade 8 Nylock Nut
- Tighten all hardware to a minimum 40 ft lbs (54.2 Nm).

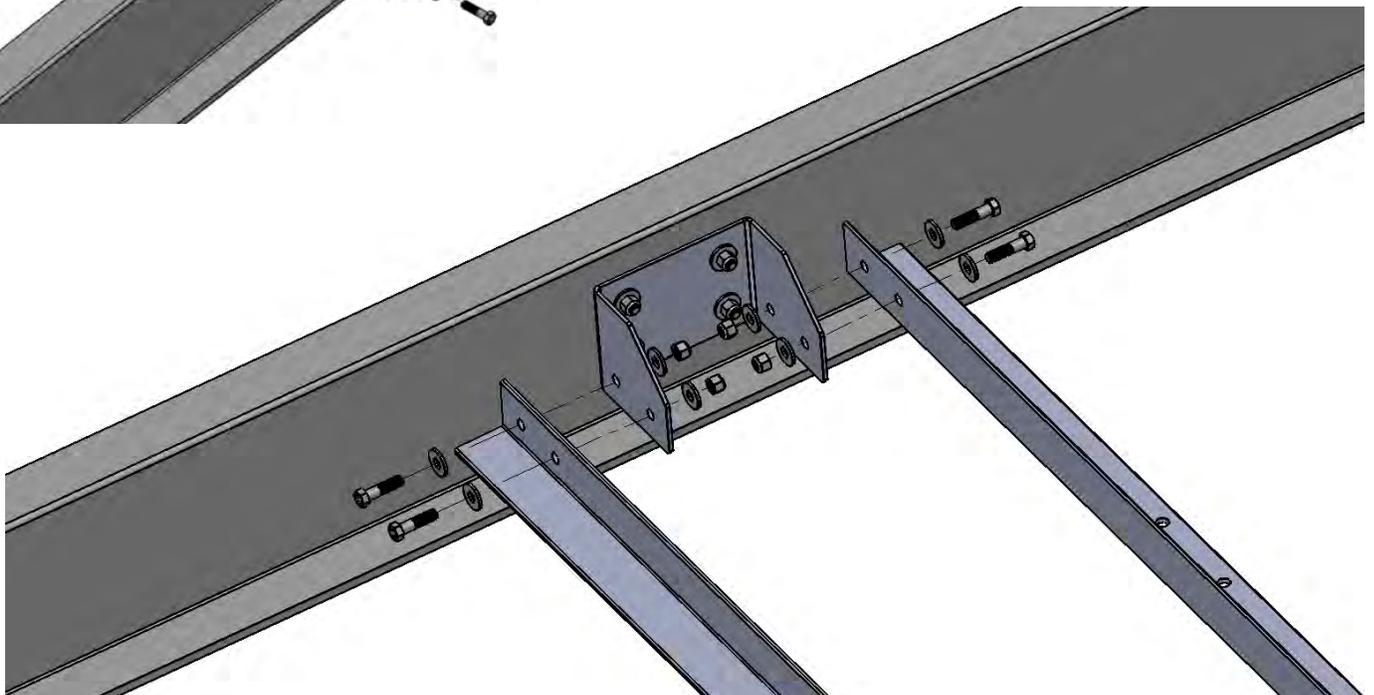

4. Standard Mount


A Standard Mount is used for 6"-10" I-Beams and all optional mounting kits. Down Tube is ordered to length.

An optional XL Mount is used for 12"-15" I-Beams and truss angle iron mounts when the truss span is greater than 8ft. This requires (4) 3"x3"x1/4" steel angles. Contact GFY for more information.

The package includes:

- (2) mfg "1" Beam Clamp Plates.
- (2) mfg "1" Beam Spacers (may or may not be required for assembly)
- (1) Upper Yoke Weldment*

*Down Tube and Lower Yoke are shown as a preview of the fan mount assembly

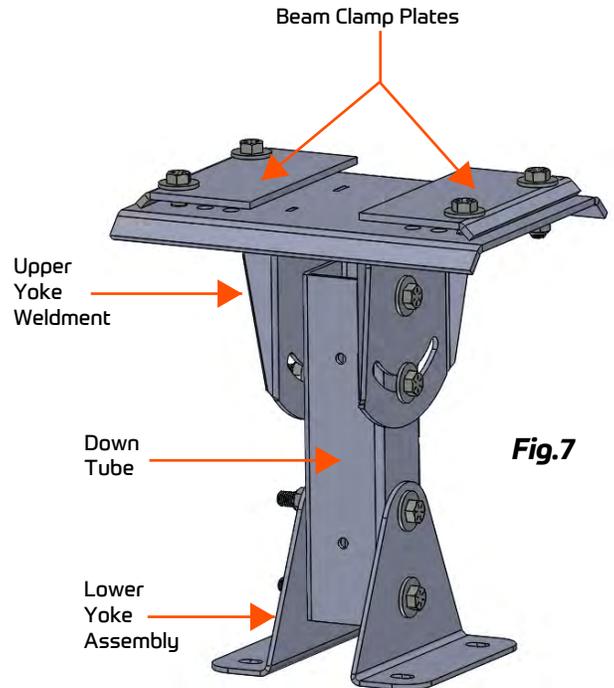

Installing the Mount



1. Secure the "1" Beam or OWSJ Beam between the mfg "1" Beam Clamps and the Upper Yoke. Insert the mfg "1" Beam Spacers if required.
2. Insert the bolts, washers and tighten to a minimum 40 ft-lbs (54.2 N·m). (Fig 8)

Upper Yoke Mounting Hardware:

- (4) 1/2"x13x2" Grade 8 Hex Cap Screw
- (8) 1/2" ASTM F436 Type 1 Mechanical Galvanized Steel Structural Flat Washer
- (4) 1/2"x13 Grade 8 Steel Nylock Nut

Tighten the bolts to a minimum 40 ft-lbs (54.2 N·m)

Insert optional shims (found in bottom tray of your fan packaging) to keep Beam Clamp Plates near level to the mounting surface of the I-Beam when the I-Beam is thicker than the bend in the Beam Clamp Plate. Shims insert on top of the Upper Yoke Assembly and are secured with the mounting hardware.

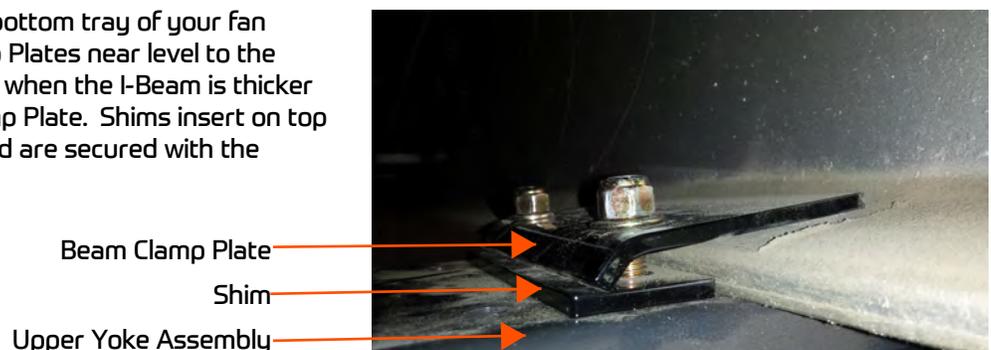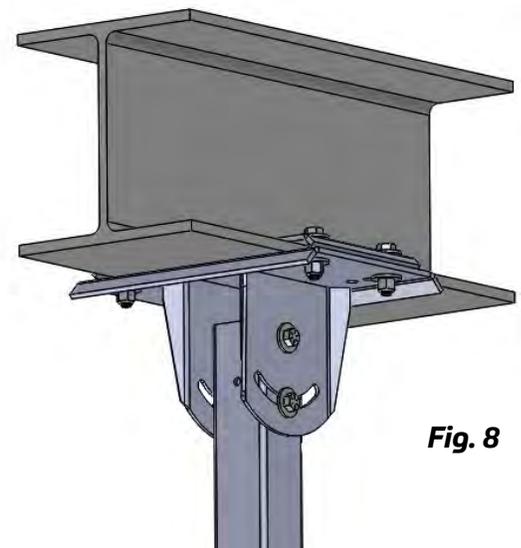

5. Down Tube

This package includes:

- (1) Down Tube
(standard 1ft, ordered to length)
- (2) Z-Tech SS™ Upper Safety Straps

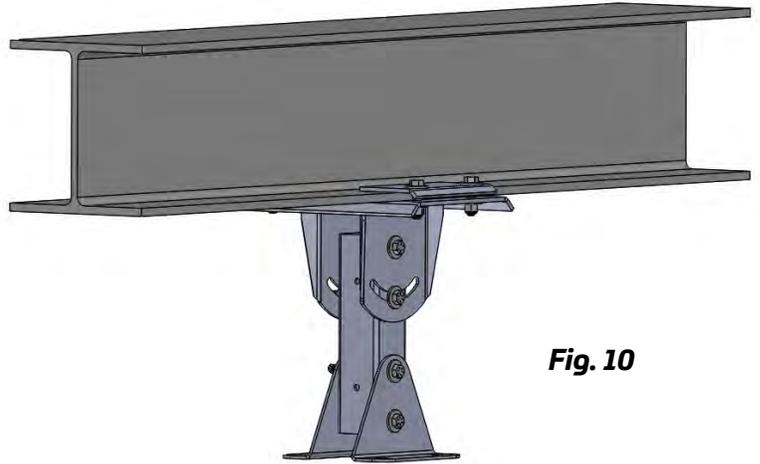


Fig. 10

NOTE Down Tubes may be ordered in lengths from 1 FT to 10 FT. Longer than 3 FT the Down Tube Kit will include a Guy Wire Kit that must be used to stabilize the fan during normal operation.

Hardware Pack:

- (4) 1/2"x13x5" Grade 8 Hex Cap Screw
- (8) 1/2"x1.375" Thru Hardened General Purpose Flat Washer
- (4) 1/2"x13 Grade 8 Steel Nylock Nut

Installing Down Tube, Upper Safety Cable, & Lower Yoke Assembly

1. Slide the upper end of the Down Tube (end with the factory installed Z-TechSS™ Safety Straps) into the Upper Yoke.
2. Loosely fasten the Down Tube into the Upper Yoke by tightening the hardware only enough to engage the nylock nut. This keeps the hardware in place while allowing the self-leveling feature of the Upper Yoke to work for you. Do NOT tighten until the Motor Hub Assembly has been securely fastened to the Lower Yoke on the bottom end of the Down Tube.
3. Wrap the upper Z-TechSS™ Safety Straps as tightly as possible around the building structure and fasten the loops with the shackle or 3/8" quick link provided.
4. Assemble the Lower Yoke onto the bottom of the Down Tube. Tighten hardware to a minimum 40 ft-lbs (54.2 Nm).
5. The lower Z-Tech™ SS Safety Straps will be secured to the bottom on the Down Tube after the Motor Hub Assembly is anchored to the Lower Yoke (see details next page).

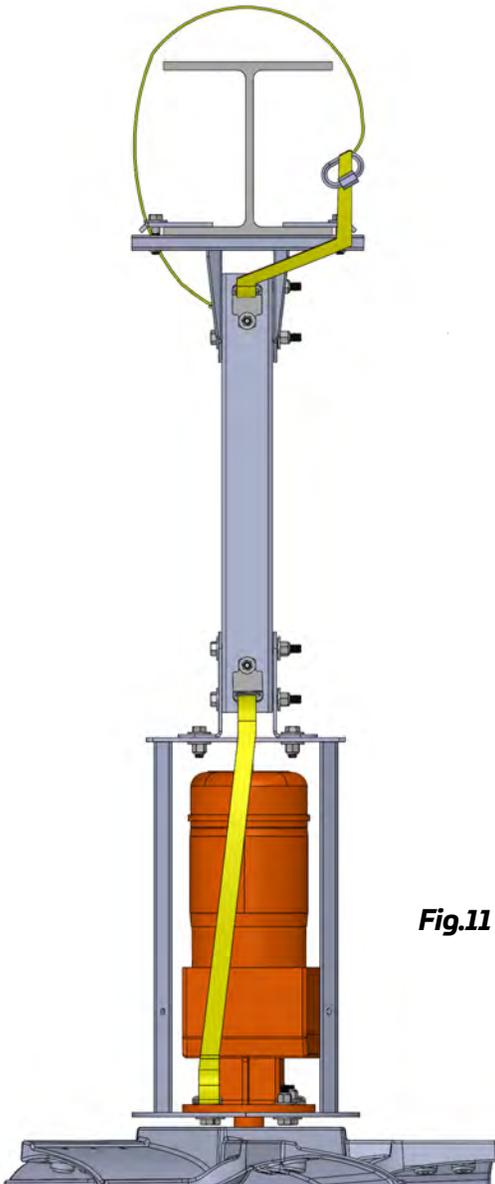


Fig.11


3/8" Quick Link

Shackle




6. Z-Tech™ SS Saftey System Makes GFY the safest fan on the market! Ships with all GFY orders. A retrofit version is also available for existing GFY fans.

Route upper straps around building support. Wrap as tightly as possible and secure with the shackle or 3/8" quick link provided.

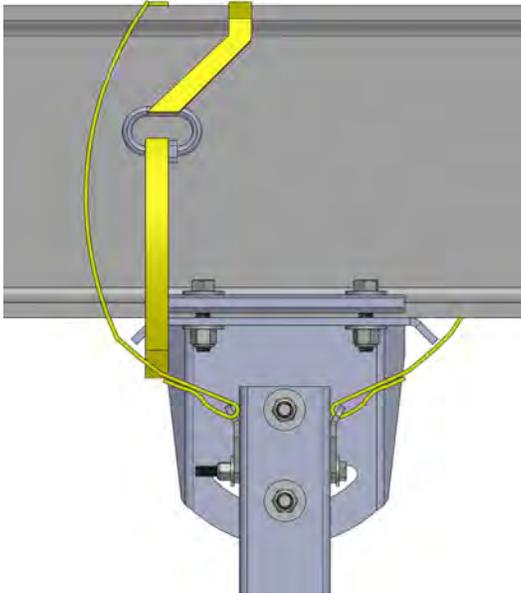


Secure the lower straps to the Down Tube with the hardware provided and tighten to a minimum of 40 ft-lbs (54.2 N.m)

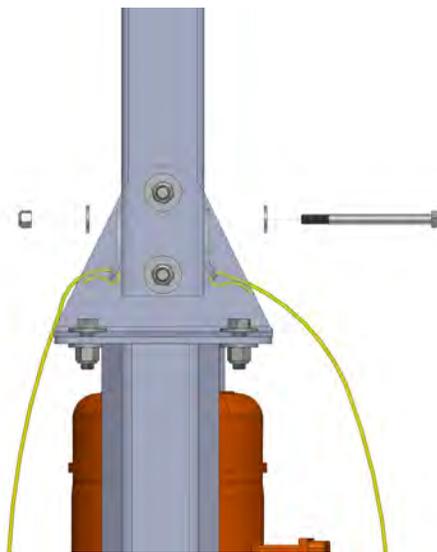

Hardware List:

- (1) 3/8" x 4.5" Grade 8 Bolt
- (2) 3/8" Grade 8 Flat Washers
- (1) 3/8" x 16 Grade 8 Nylock Nut

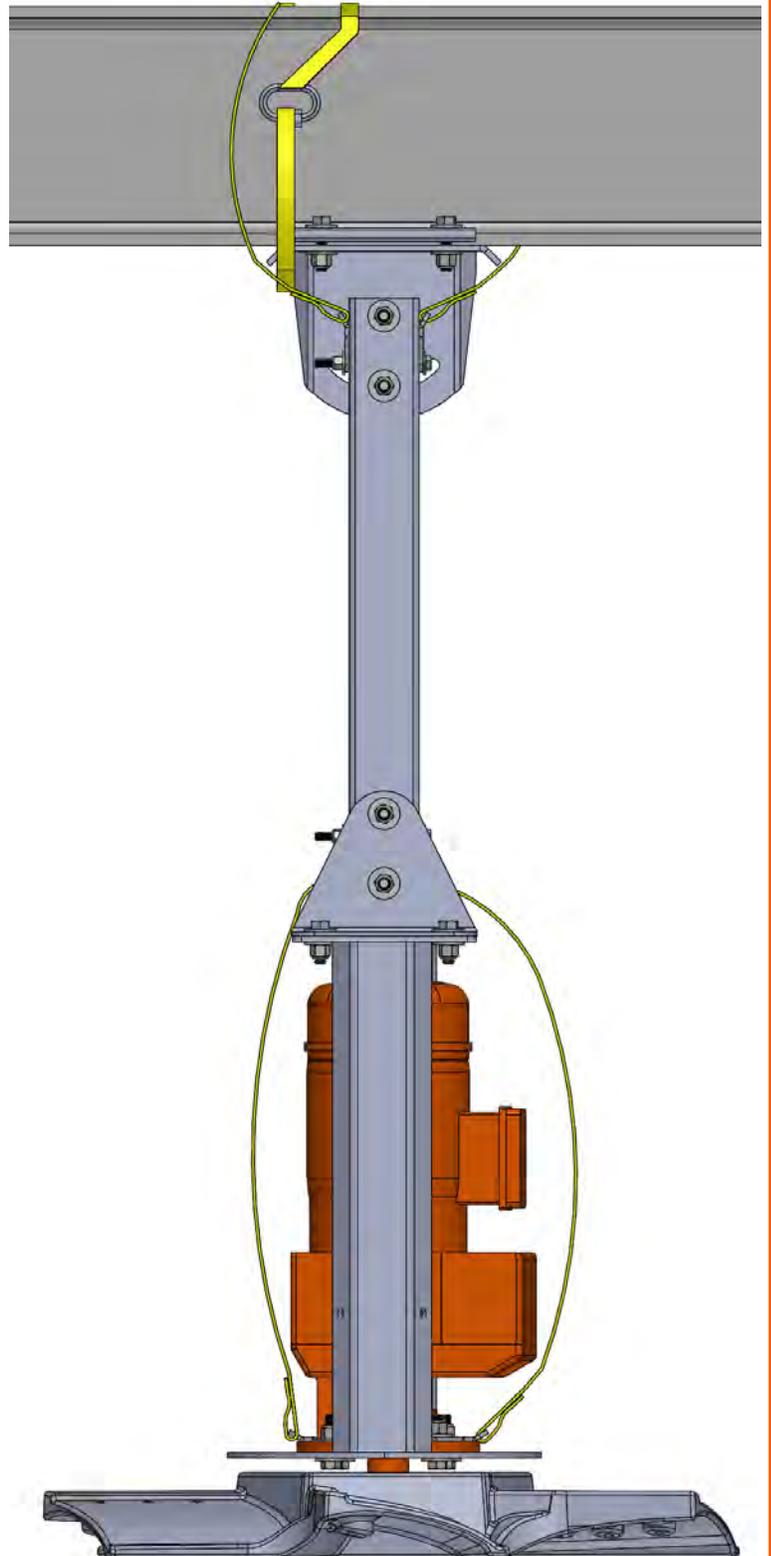

6. Main Hub and Drive Assembly

The package includes:

- (1) Hub.
- (1) Fan frame
- (1) Motor
- (1) Gearbox

Hardware Pack Includes:

- (4) 1/2"x13x1.5" Grade 8 Hex Cap Screw
- (8) 1/2" ASTM F436 Type 1 Mechanical Galvanized Steel Structural Flat Washer - Grade 8
- (4) 1/2"x13 Grade 8 Steel Nylock Nut

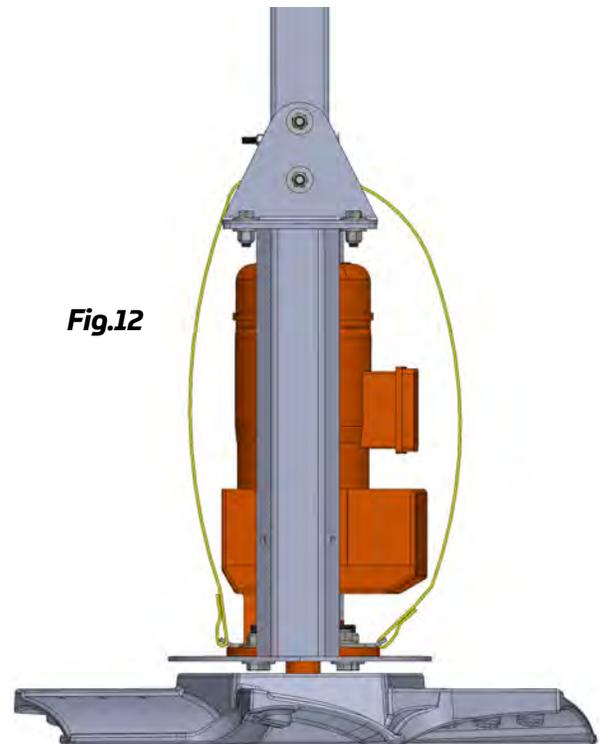


Fig.12

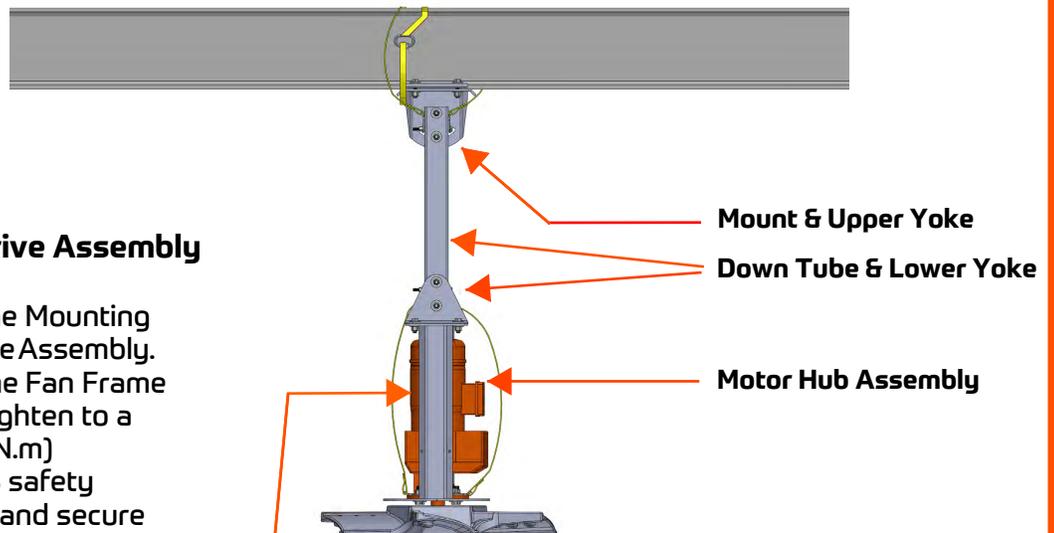


Fig.13

Installing the Main Hub & Drive Assembly

1. Raise the fan and align the Mounting Plate with the Lower Yoke Assembly.
2. Fasten the top plate of the Fan Frame to the Lower Yoke and tighten to a minimum 40 ft-lbs (54.2 N.m)
3. Attach both Z-Tech™ SS safety straps to the down tube and secure with the hardware provided (see Fig. 11)
4. Verify fan level by checking both directions on the vertical post of the fan frame.
5. Tighten the Upper Yoke/Down Tube hardware to a minimum 40 ft-lbs (54.2 Nm) to secure the fan level.

Check fan level by placing the level on the front and side of either vertical post of the fan frame.


7. Optional Guy Wires (standard when down tube longer than 3FT)

The package includes:

- (4) Cable 1/8" Stainless Steel (4 @ 20 FT provided)
- (8) Thimbles 1/4" Stainless Steel
- (16) Cable Clamps 1/8" (Use 2 per Anchor Location)
- (4) Turnbuckles 3/8" x 6" 1200# Galvanized eye to eye
- (4) Quick Links 3/8"

Contractor Supplied Hardware For Anchor Points:

- (4) 3/8" eyebolts (1 1/2" longer than the thickness of the anchor point)
- (4) Nuts 3/8"
- (8) Washers 3/8"
- (4) Nylock Nuts 3/8"

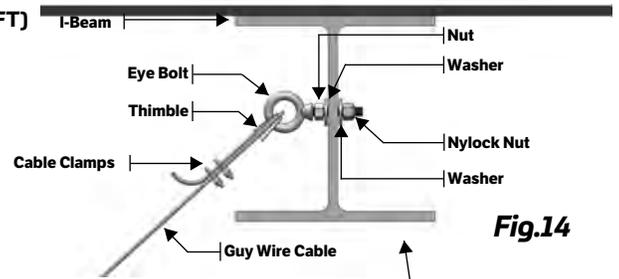

Ceiling/Roof Deck

Guy Cables should be snug, NOT tight. Recheck fan level after tensioning Guy Wires


When placing cable clamps on the wire it is critical the U-Bolt side of the clamp is placed on the short, turn-back end and the saddle goes on the long end running from the anchor point to the fan (see detail below).

Fig.15


45° to 60°

To the anchor point.

Guy Wires are not a safety mechanism. They prevent fan oscillation when Down Tubes get longer than 3FT.

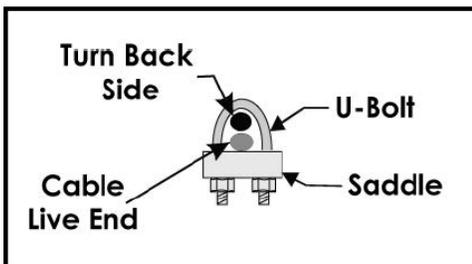

Tighten cable clamp hardware to a minimum 4.5 ft-lbs (6.1 N·m)

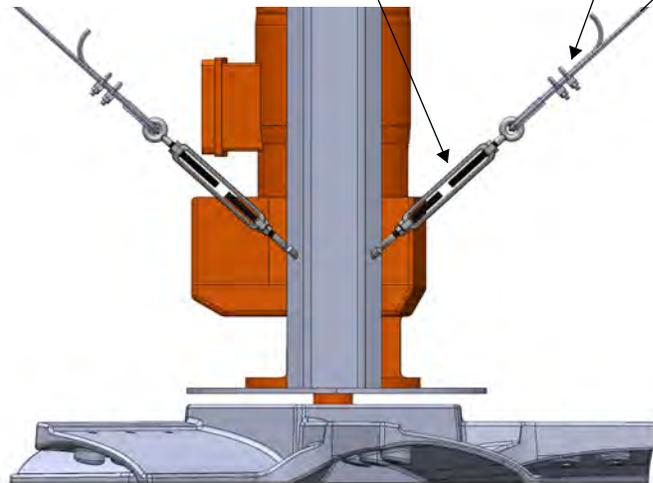

Installing the Optional Guy Wires

1. Determine mounting position on ceiling and establish the angle between 45° - 60° for the cable. Determine correct location on the I-Beam to drill the hole for the eye bolt. For example, if the guy wire anchor points on the fan are 3' 4" (101.6 cm) down from the I-Beam or Steel Angles the cables should anchor at least 3' 4" (101.6 cm) away from fan.
2. Install an eye bolt with nuts and washers in I-beam as per Fig. 14.
3. Measure the run of cable required and cut approximately 2 FT longer. NOTE: runs longer than 18 FT will require additional cable.
4. Secure it with 1 thimble and 2 cable clamps (Fig.16). Repeat using the other 3 pieces of guy wire cable, thimbles and cable clamps (Fig.15) Guy wires should be snug but not overstressed to allow free self-levelling. They should also be approximately 90° apart (Fig.17).
5. (Fig.17).

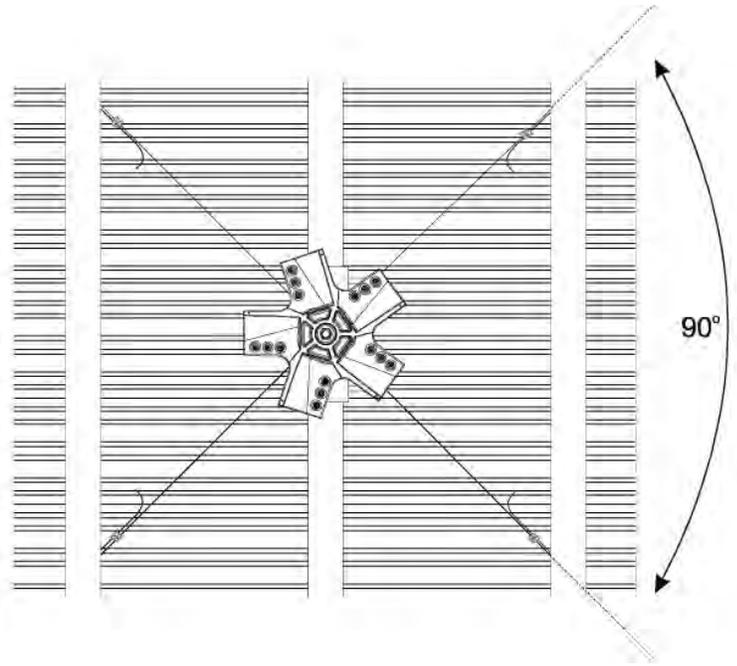


Fig.17

NOTE: Fans hanging lower than 10ft from where the guy wires will mount may require additional cable (provided by the installer).

8. Z-Tech™ Blade Assembly

- (5) Blades
- (5) Blade Stabilizer Plate
- (15) $3/8$ "x 16 x 3.5 " Grade 8 Hex Cap Screw
- (30) $3/8$ "x 0.812 "Grade 8 Flat Washer
- (15) $3/8$ "x 16 Grade 8 Nylock Nut

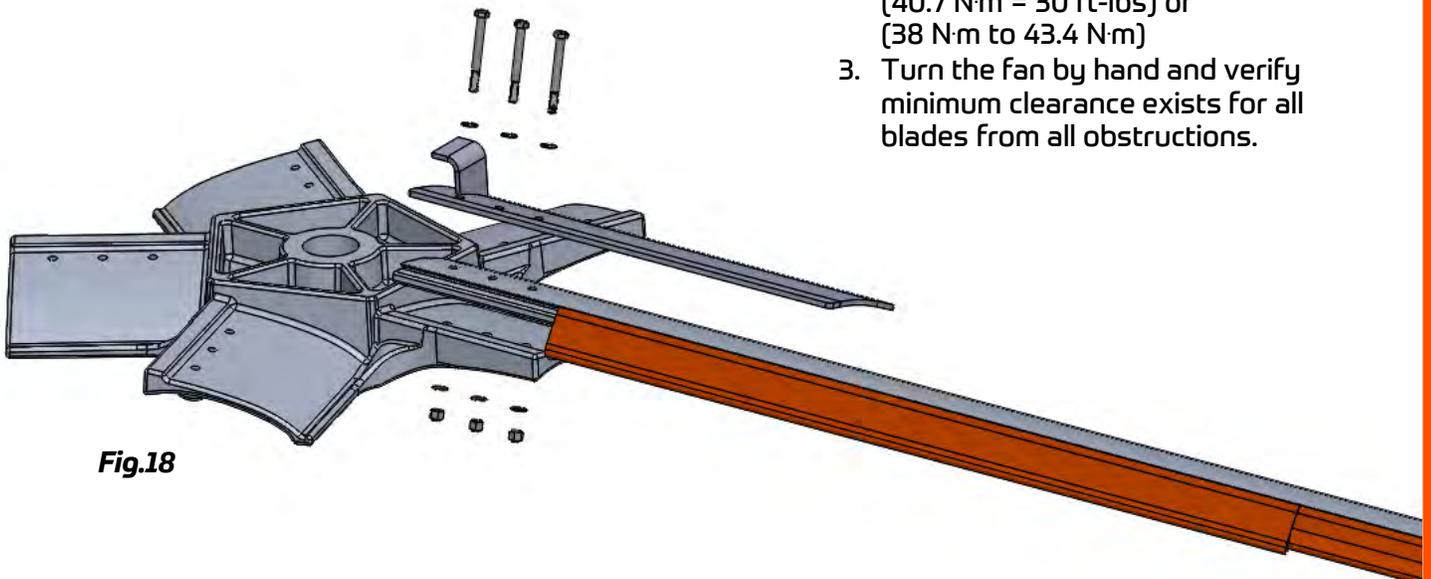


Fig.18


Installing the Blade Assembly

1. Clamp blade between blade stabilizer plate and hub.
2. Continue until all 5 blades have been fastened and tighten to:
30 ft-lbs +/- 2 ft-lbs
(40.7 N·m = 30 ft-lbs) or
(38 N·m to 43.4 N·m)
3. Turn the fan by hand and verify minimum clearance exists for all blades from all obstructions.

9. Leveling the Fan

1. After your fan is installed, check the level again by placing your level vertically on the vertical post of the fan frame. Adjust as required.
2. Once leveled, tighten hardware to a minimum 40 ft-lbs (54.2 N.m) to secure the Down Tube into the Upper Yoke. Verify fan level once hardware is tightened.

Fig.19

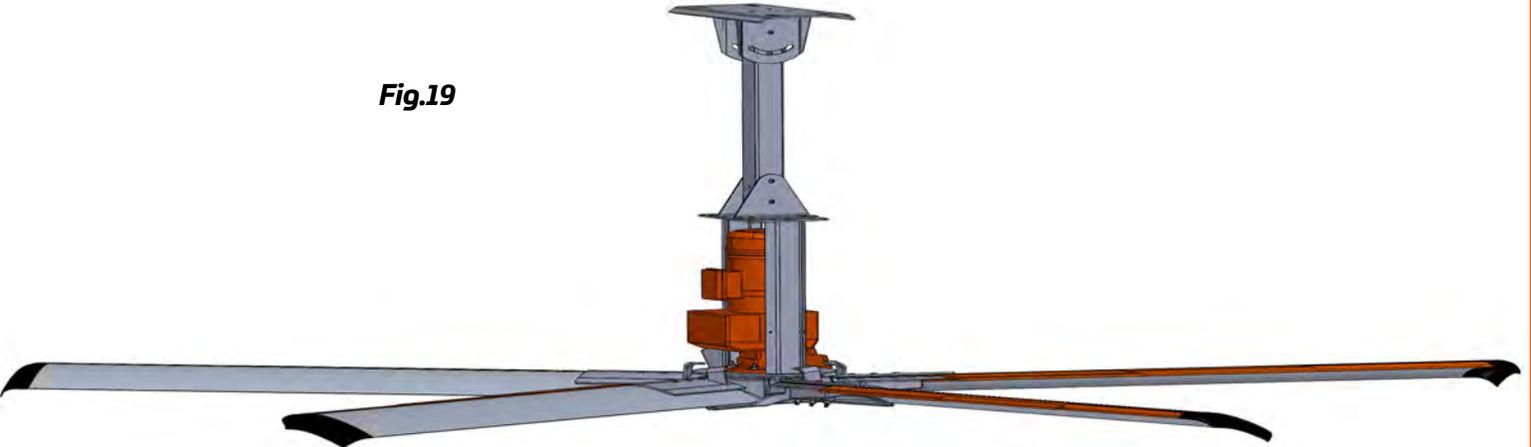

ATTENTION! Motor Gearbox Vent Failure to remove the vent stopper will cause gearbox failure!!

1. Remove rubber stopper from the gearbox
2. Discard after removal.

ABB Dodge Motor Vent Plug



ABB Dodge vent plug shown in place. This must be removed before motor operation.



Vent shown with plug removed.

For proper electrical connection, please consult the Wire Connections (Motor) page later in this document.

Electrical Installation & Operation Manual

All installation wiring must confirm to your National Electrical Code and local guides. While we believe that using Go Fan Yourself® controls and following our instructions will result in an installation that meets those requirements, we cannot guarantee it. Code compliance is ultimately the installer's and/or user's responsibility.

Subject to change without notification.

IMPORTANT

Wind can flex fan blades a great deal. Increase blade clearance from 2 FT to anything above the blades to 3 FT on all project where the fan may be exposed to the wind.

Safety Precautions

- All installations must be installed by a qualified person.
- Do not work on live equipment. Use lock out/tag out procedures.

CRITICALLY IMPORTANT!!

Upon completion of the installation you MUST complete the GFY® Check In/Close Out Form and take two pictures:

- 1) The overall fan installation.
- 2) Close up of the fan mount clearly showing both safety cables routed properly, snug, and secured with the hardware provided.

Please send the completed GFY® Check In/Close Out form and these pictures to drew@gofanyourself.com

Wire Requirements

- GFY recommends 600v 12 ga stranded wire for all 3 phase GFY installations.
- GFY recommends 600v 12 ga stranded wire for all 1 phase GFY installations.
- Size of input and output wires may go up based on length and current draw of VFD and motor.
- See Power Requirements (page after next) for current draw of VFD and motor.

VFD = Variable Frequency Drive

A separate insulated ground must be provided to each VFD from the electrical panel.


Motor is rated with an Insulation Class H or F; Ensure proper wiring is used as per current electrical codes.

Wet/Agricultural - PVC Conduit
Dry (Industrial/Commercial) - EMT Conduit

Wet/Agricultural - PVC Conduit
3 Phase = shielded cable, inverter-rated,
(3) 12g Wires + Insulated Ground

3 Phase = (3) 12g Wires + Insulated
Ground
1 Phase = (2) 12g Wires + Insulated
Ground

Dry (Industrial/Commercial) - EMT
Conduit
3 Phase = (3) 12g Wires +
Insulated Ground

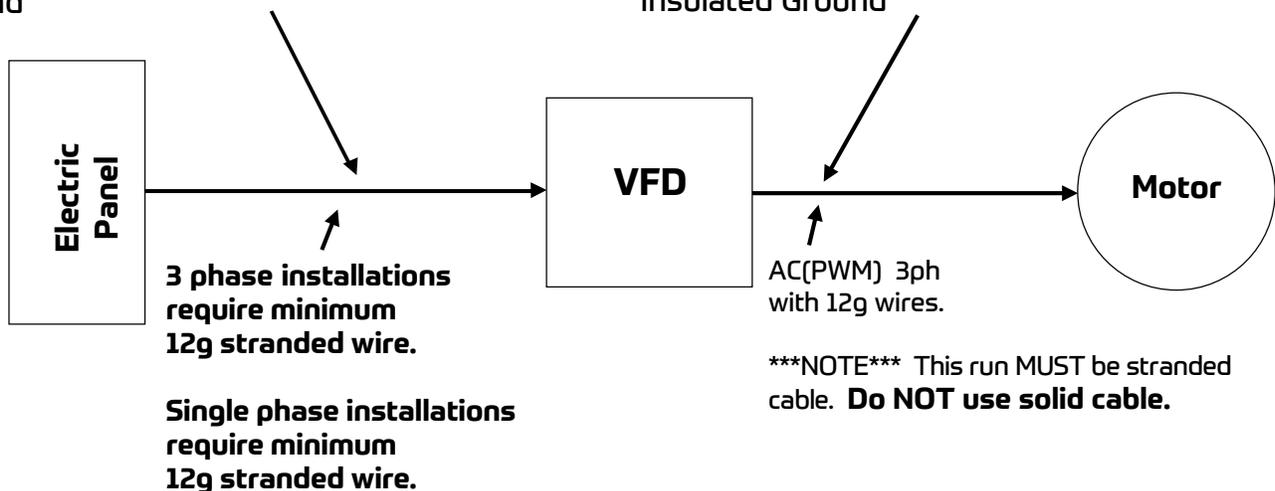

Maximum Cable Length

100-120 VAC	1 Phase	Max 200 ft	No HP Change
200-240 VAC	1 Phase	Max 200 ft	No HP Change
200-240 VAC	3 Phase	Max 200 ft	No HP Change
380-480 VAC	3 Phase	Max 200 ft	No HP Change

If lengths beyond 200' are required the best practice is to order the optional "Wall Mount Keypad Kit" or remove the keypad from the drive and mount the keypad to a 4x4 J-Box with a Drywall Ring. Some onsite fabrication required. Maximum CAT5 cable length is 300ft. Contact your salesperson or local GFY® representative for more information.

For installations with cable lengths exceeding a 200' run from the VFD to the Motor please consult the factory at: 1-844-GOFANME (463-2663).

The data cable connecting the keypad is very short and must be removed carefully whenever the ABB VFD Case is opened.

1. Remove the (4) machine screws from the cover.
2. Reach in and press down on the data cable tab and gently unplug the keypad.
3. Remove the cable for the "two tab" strain relief system.
4. Place the cover in a safe location while work is being completed inside the drive.

To replace the cover once work is finished reverse the cover removal process.

1. Lift the cover up to the drive.
2. Being sure to leave enough slack in the data cable engage the "two tab" strain relief system.
3. Gently plug the drive into the keypad. Be sure the cable seats securely.
4. Be sure the cover gasket is properly seated.
5. Fasten the cover with the (4) screws removed.

Power Requirements

18ft, 20ft, 22ft & 24ft Fans

Required Line Circuit Size

GFY-Z-XX-460 (fan powered by 380-480V 3 phase)	= 3.5 amps	- 10 amp
GFY-Z-XX-230 (fan powered by 200-240V 3 phase)	= 7.0 amps	- 10 amp
GFY-Z-XX-240 (fan powered by 200/240V 1 phase)	= 15 amps	- 20 amp

14ft & 16ft Fans

GFY-Z-XX-460 (fan powered by 380-480V 3 phase)	= 2.65 amps	- 10 amp
GFY-Z-XX-230 (fan powered by 200-240V 3 phase)	= 5.3 amps	- 10 amp
GFY-Z-XX-230-1 (fan powered by 200-240V 1 phase)	= 12 amps	- 20 amp

8ft, 10ft & 12ft Fans

GFY-Z-XX-460 (fan powered by 380-480V) 3 Phase	= 2.65 amps	- 10 amp
GFY-Z-XX-230 (fan powered by 200-240V) 3 Phase	= 5.3 amps	- 10 amp
GFY-Z-XX-230-1 (fan powered by 200-240V) 1 Phase	= 12 amps	- 20 amp

Wire Location

- DO NOT RUN input and output power cables in the same conduit.
- DO NOT RUN control cables with any power cables in the same conduit.
- DO NOT RUN different fans output power cables in the same conduit.
- You can run different fans input power cables in the same conduit.



Input Power

- 3 Ph use L1 – L2 – L3 + PE (Ground)
- 1 Ph use L1 – L2 + PE (Ground)


- 120VAC - L1 = Hot
 - L2 = Neutral
- 240VAC - L1 = Hot
 - L2 = Hot

NOTE: All single phase applications must be wired as 200-240VAC 3 phase applications from the VFD controller to the fan motor. The controller will change the 1 phase power it is receiving and supply 200-240VAC 3 phase power to the motor.

GFY® Connection For ESFR Suppression System ACS355 Controller - 200-240VAC & 380-480VAC 3 Phase Applications Only


- 1) Primary Method - The Control is designed to take a PNP (Sourced) +24 VDC signal from an ESFR fire suppression system. The ESFR system will supply the +24V DC power.
 - o Digital Input "DI3" (POS. 14) = +24V signal wire.
 - o DCOM (POS. 11) = 0V common signal wire.
 - o The Drive will go in to an alarm condition when the +24VDC signal is lost. Fan operation is prevented and the Control will stay in the alarm condition until the +24VDC signal is restored.

- 2) Alternate Solution - Run the output from Pin 9 (+24VDC) to a relay and run the output from the relay to Pin 14 (Digital Input 3 "DI3"). Control the relay with the ESFR fire suppression system.

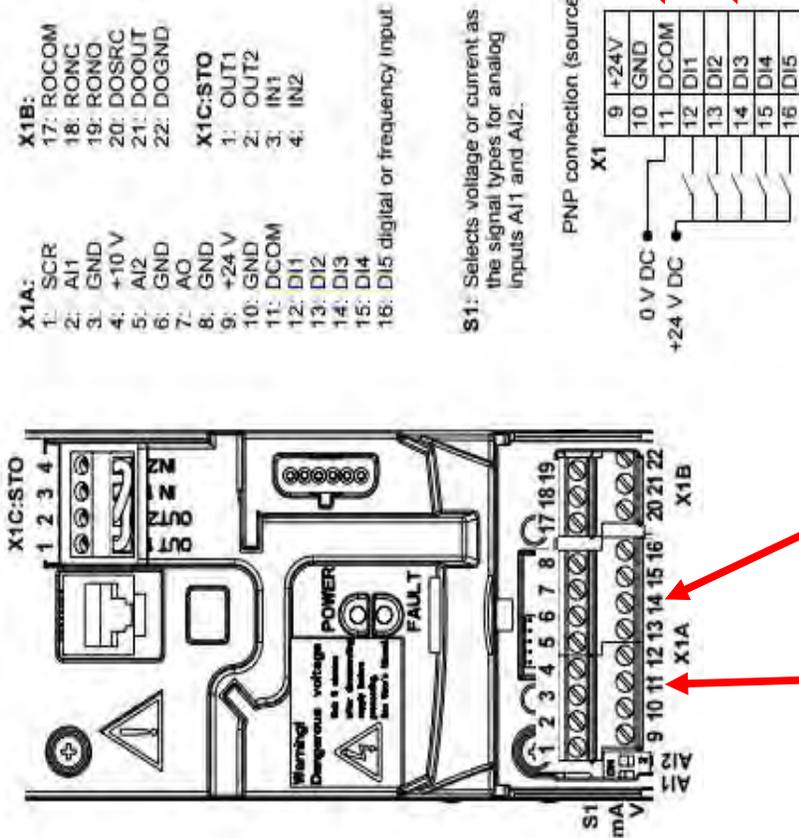

+24 VDC ESFR Digital Input

0 VDC DCOM From ESFR Circuit

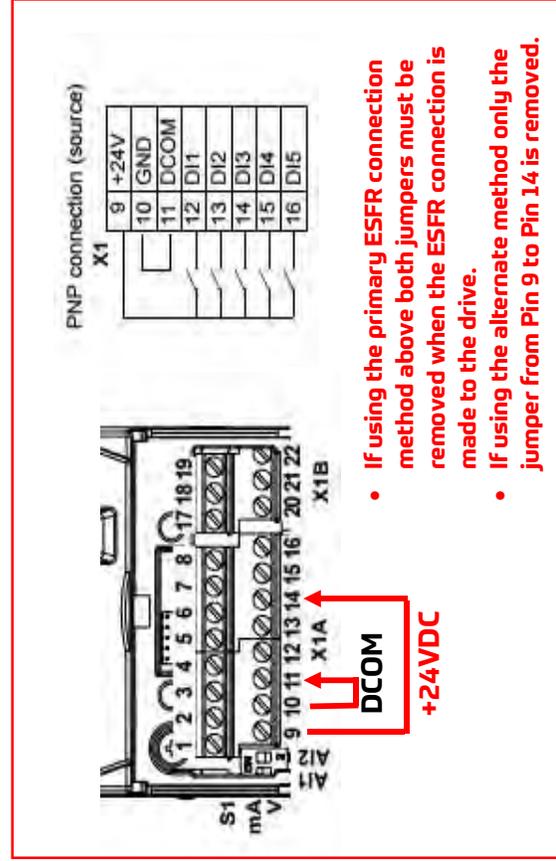

- If using the primary ESFR connection method above both jumpers must be removed when the ESFR connection is made to the drive.
- If using the alternate method only the jumper from Pin 9 to Pin 14 is removed.


GFY® Connection For ESFR Suppression System

ACS255 Controller - 100-120VAC & 200-240VAC Single Phase Applications


This diagram is designed to take a PNP (Sourced) +24 VDC signal from an ESFR fire suppression system. The ESFR system will supply the +24 VDC power.

Run the +24 VDC signal wire to terminal 4 and route 0V COM to terminal 7. There should be room in the terminal block to accept both wires on terminal 7.

To enable the ESFR signal input see the programming steps below. The drive will go into a fault condition once the 24VDC signal is lost and will not allow fan operation until that signal is restored.

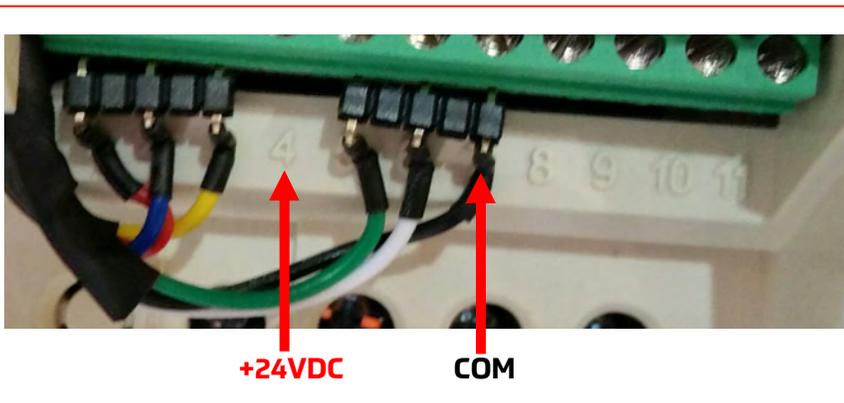

Programming Instructions for GFY® ACS255 Controller - Enable ESFR Input

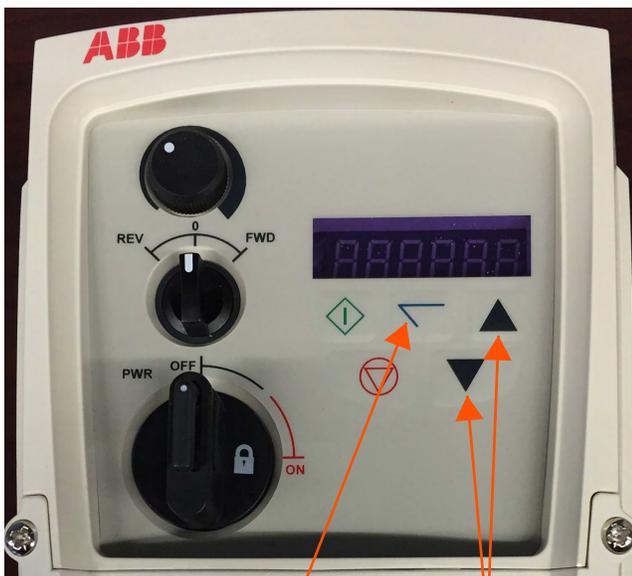

Enter/Select Up/Down Arrows

- 1) Once ESFR connection is complete from fire suppression system. Power up the drive.
 - a) Display should say "SToP".
- 2) Hold "Enter/Select" for 1 second.
 - a) Drive will enter programming mode.
 - b) PAR S (parameter short list) should be displayed.
 - c) Press "Enter/Select".
 - d) Display should show 4 digits (they may be "0000").
- 3) Use Up/Down Arrow Keys and locate parameter 9902.
 - a) Press "Enter/Select" to select.
- 4) Use Up/Down Arrow Keys to change parameter 9902 setting to "6".
 - a) Press "Enter/Select" to save.
 - b) Display should return to parameter 9902.
- 5) Press and hold "Enter/Select" until display reads "StoP". You have exited programming mode.
- 6) Drive will immediately fault if ESFR signal is missing.

Wire Connections (Motor) ABB Dodge Motor

Always wire the motor per the wiring diagram on the inside of the motor cover plate. All single phase applications MUST be connected as "Low Voltage".

**Voltage Supply to the ABB VFD Controller:
380-480VAC 3 Phase**

Connect the motor for High Voltage

Voltage Supply to the ABB VFD Controller:

**200-240VAC 3 Phase
200-240VAC 1 Phase
100-120VAC 1 Phase**

Connect the motor for Low Voltage




Low Voltage Wiring

T1 to T7 and L1 (incoming 208-240 VAC)
T2 to T8 and L2 (incoming 208-240 VAC)
T3 to T9 and L3 (incoming 208-240 VAC)
T4 to T5 and T6 (tie together)
T5 to T4 and T6 (tie together)
T6 to T4 and T5 (tie together)
T7 to T1 and L1 (incoming 208-240 VAC)
T8 to T2 and L2 (incoming 208-240 VAC)
T9 to T3 and L3 (incoming 208-240 VAC)

High Voltage Wiring

T1 to L1 (incoming 480VAC)
T2 to L2 (incoming 480VAC)
T3 to L3 (incoming 480VAC)
T4 to T7
T5 to T8
T6 to T9
T7 to T4
T8 to T5
T9 to T6

Quick Operations Instructions for the VFD Controller ACS355 ABB Control

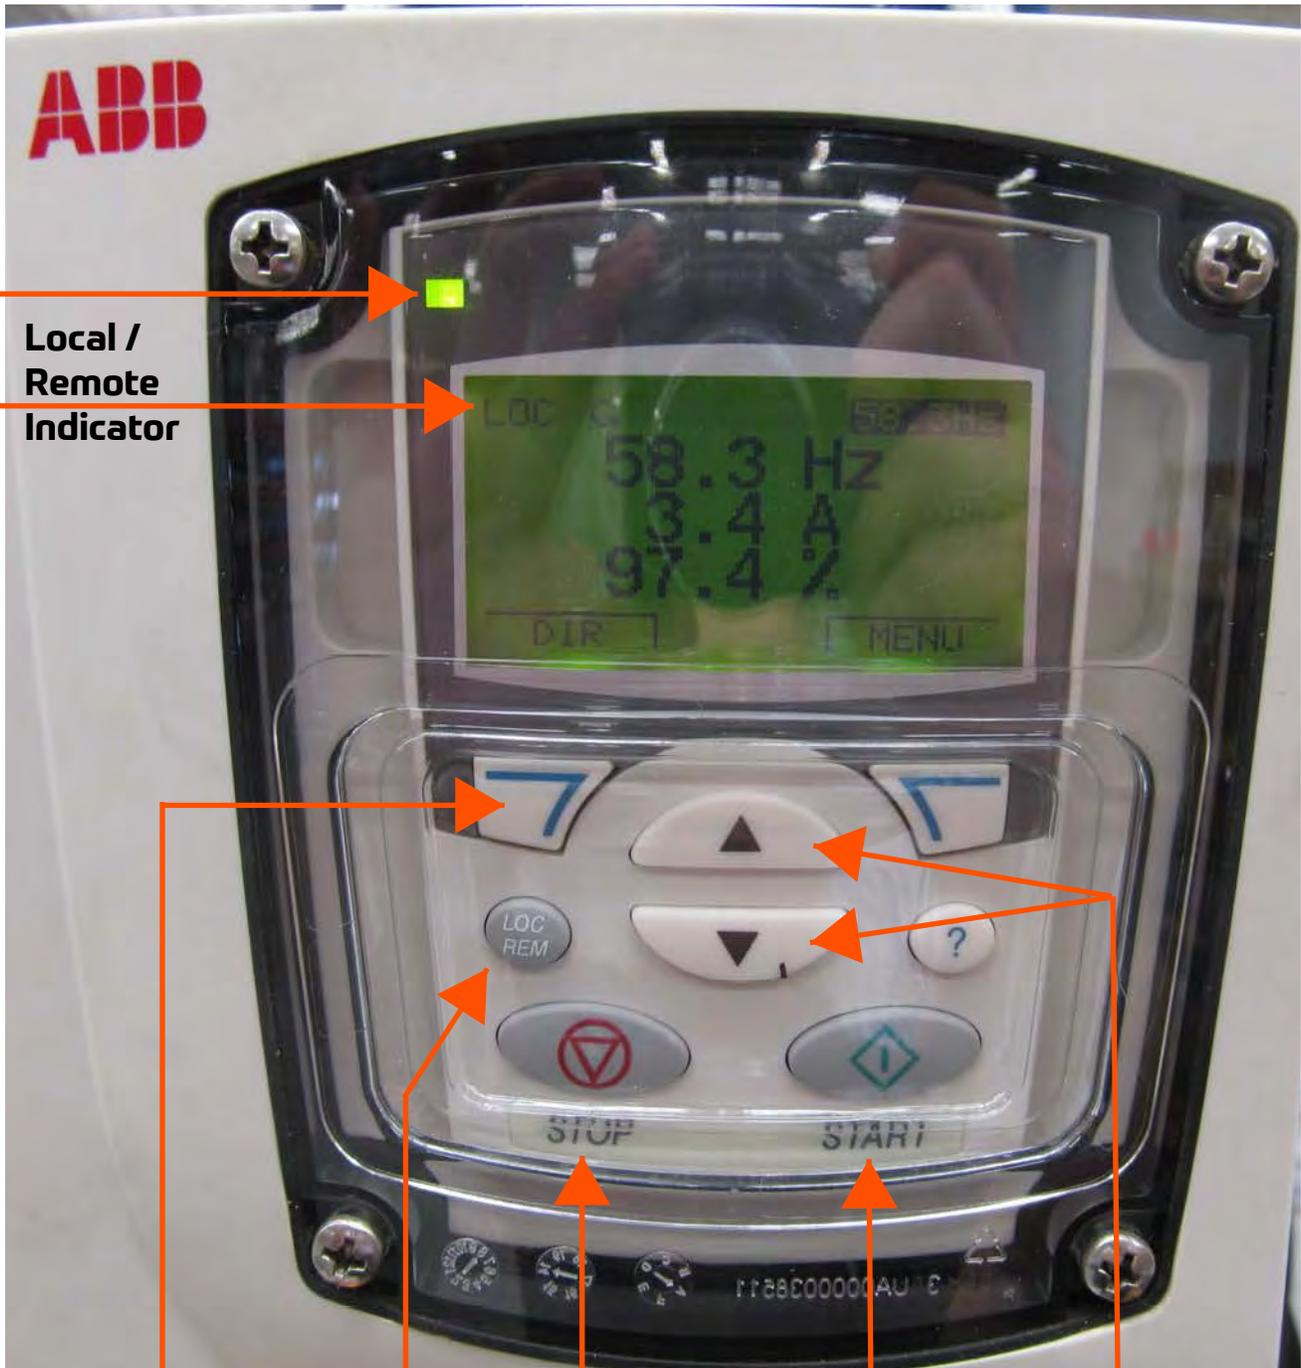

Local / Remote Indicator

To Change Direction:

To Stop:


To Start:

To Change Speed:

Local / Remote - If keypad controlled may be in local or remote mode: LOC or REM
If controlled by a control system must be in remote mode: REM

LED Condition: Solid Green - Fan is ready for use.
Flashing Green - Fault detected. Fan may operate. Investigate fault and clear.
Flashing Red: Fault detected. Fan will not operate until fault is cleared.

Quick Operations Instructions for the VFD Controller ACS255 ABB Control

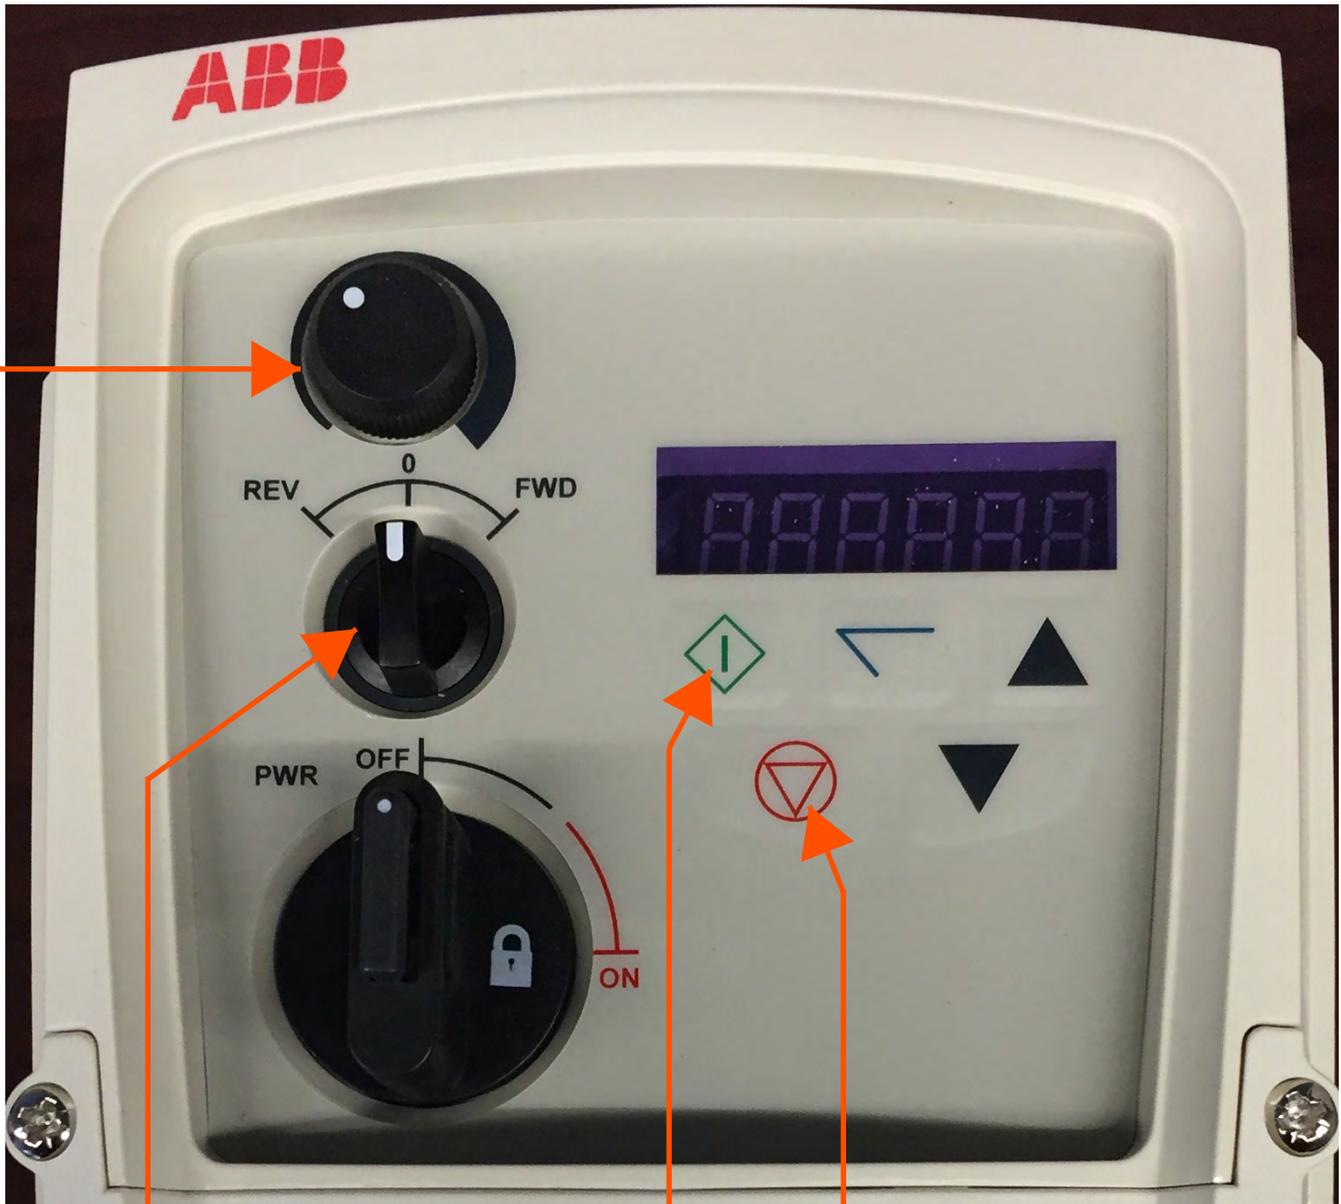

Stop/Select Direction:

Both Buttons Disabled

To Change Speed:

- The display will have an "H", indicating "Hertz". The frequency (or speed) the fan is turning will be indicated numerically. H - 45.8 for example.
- The word "STOP" will be shown any time there is power applied to the drive but the fan is not turned on. STOP indicates the fan is on and ready for use.

Best Practices for General Fan Operation Using The ACS355 ABB Control

To Turn the Fan On:

- Turn the Lock Out/Tag Out disconnect in the lower left hand corner of the controller to the "ON" position.
 - The disconnect turns fairly hard to avoid accidental movement.
- The ACS355 controller will go through a start up sequence.
- Once start up is complete the fan will show the home screen showing operational parameters:
 - Hz - The value of hertz the variable frequency drive is sending to the motor.
 - A - The amps the fan is drawing.
 - %- The percentage of full speed the fan is currently running.
 - Initially after start up all these values should read "0".

To Start the Fan Spinning:

- Once the ACS355 controller has completed its start up sequence as detailed above press the "Start" button.
 - This will cause the fan to begin turning in the direction of and at the speed of its last setting when the "Stop" button was pressed.
 - To change speed use the arrow buttons.
 - Look at the number in the upper right hand corner of the display. This shows the Hz value the fan is programmed to run at.
 - Once you see the value of Hz you want the fan to run at release the arrow key.
 - The fan will now ramp up or down to the new setting.
 - The "Hz" display on the fan will show the actual ramp speed of the fan until it reaches the new setting.

To Reverse Direction:

- Simply press the "DIR" soft key as indicated by your quick operations guide in this manual.
 - The fan is programmed to ramp down until full stop is achieved for a split second and then reverse direction and ramp up to the last speed it was running in the new direction.

To Remove Power From the Fan for Service Work:

- Press the stop button and wait for the fan to completely stop.
- Turn the disconnect to the "Off" position and perform Lock Out / Tag Out.

Best Practices for General Fan Operation Using The ACS255 ABB Control

To Turn the Fan On:

- Turn the Lock Out/Tag Out disconnect in the lower left hand corner of the controller to the "ON" position.
 - The disconnect turns fairly hard to avoid accidental movement.
- The ACS255 controller will go through a start up sequence.
- Once start up is complete the fan will display "SToP" indicating it is ready for use.

To Start the Fan Spinning:

- Turn the selector switch to "FWD" for cooling operation or "REV" for destratification only operation.
- Adjust the speed of the fan with the dial selector.

To Reverse Direction:

- Simply turn the selector switch to "FWD" or "REV" as indicated by your quick operations guide in this manual.
 - The fan is programmed to ramp down until full stop is achieved for a split second and then reverse direction and ramp up to the speed indicated by the dial selector.

To Remove Power From the Fan for Service Work:

- Turn the selector switch to "0" and wait for the fan to completely stop.
- Turn the disconnect to the "Off" position and perform Lock Out / Tag Out.

Recommended Maintenance Schedule


1. No maintenance shall be done on the fan, mount or guy wires while in operation or powered. Complete Lock Out/Tag Out measures on the fan before work is begun.
2. No maintenance shall be done on the fan controller while powered unless the task involves reprogramming or troubleshooting the electrical system. Complete Lock Out/Tag Out measures on the circuit before work is begun.
3. No maintenance shall be done within a 20ft horizontal radius of the fan and 4ft below and none above the blade level while the fan is in operation.
4. While doing maintenance on the fan, mount, or guy wires, a safety barrier shall be erected at a radius of 20ft of the center of the fan.
5. The fan controller shall be locked out while maintenance is ongoing on the fan, mount, or guy wires.
6. All personnel working on the fan, mount, or guy wires, shall wear the appropriate personal safety equipment as mandated by local, provincial, and national regulations.
7. A risk assessment shall be performed before any work is done. A checklist shall be completed and shall include any emergency contacts for the area.

NOTE: Maintenance schedule is based on running 5,000 hrs/year and is a guideline to ensure safe and continuous operation of the fan(s). In cases of extreme operation (e.g. high humidity, aggressive environment, or large temperature variations), shorter intervals between service is recommended.


Safety Precautions

1. Z-TechSS™ Safety System installed per this Z-Tech™ Fan installation manual.
2. Guy wires (if equipped) installed as per Fig. 14, 15, 16 & 17 in this Z-Tech™ Fan installation manual.
3. Blade Stabilizer Plates installed as per Fig.18 in this Z-Tech™ Fan installation manual.
4. See next page for required clearances.
5. If installed in storage facility between racks, signs must be installed identifying fan locations.
6. The ABB variable frequency drive has several safety features such as current limit, motor overload, minimum, maximum and ramp speed control. The controller also features a LOTO disconnect all housed within a NEMA 4X enclosure.


Z-Tech™ Fan Clearance Requirements

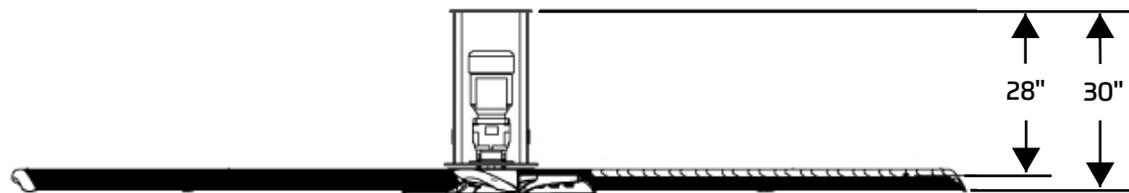

Fan Frame Detail

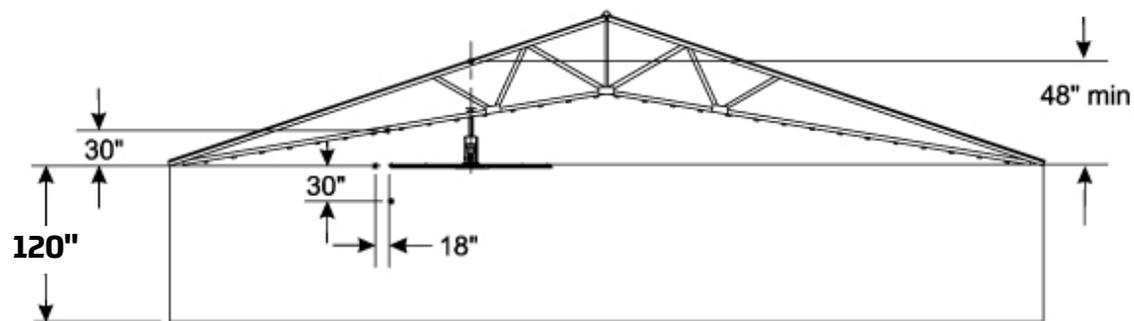

Sloped Roof

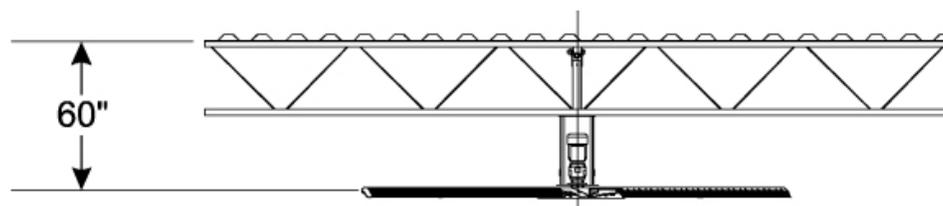

Flat Roof

Clearances

- Min 60" center of fan to roof deck for ideal operating performance without compromising overall fan performance
- Min 24" from fan blade's leading edge to obstruction above or below fan
- Min 18" from side of fan to any obstruction
- Min 120" floor to fan blade tip or lowest point of the fan

Contractor is responsible for verifying all site conditions to include field dimensions where applicable. If the contractor elects to make any changes without notifying Go Fan Yourself® the contractor is responsible for the same. All drawings are to be used as general architectural intent unless otherwise stamped. See Engineer drawings for structural design information. Contractor to ensure that all building departments and authorities are informed in regard to the work and that all permits are attained before commencing work.

GFY Annual Performance Plan

We're here to help you keep your warranty active and protect your air movement investment!

Certified Services Performed

- 1) Integrity of safety system.
- 2) Verify blade connection.
- 3) Inspect hub, blades and **Z-Tech™** leading edges for proper operation.
- 4) Inspect **ABB** VFD parameters and performance.
- 5) Check fault log and record if any are reported.
- 6) Check **ABB/Baldor** motor performance & operation
- 7) Check **ABB/Baldor** gearbox performance & operation including breather (if equipped).
- 8) Integrity of electrical connections.
- 9) Check fan mounting structure and fan level and plumb.
- 10) Verify hardware connections.
- 11) Verify guy wire tension and inspect cables and connections (if equipped).
- 12) Visual inspection of equipment.
- 13) Enhance **GFY** equipment by adding **Z-Tech™SS** retrofit (**Z-Tech™**, **Z-Tech3™**, **Z-Chill™** only).
- 14) Document any customer observations.
- 15) And we even clean the fan!

It's EASY!!

- 1) Request a quote from GFY for your Annual Performance Plan: info@gofanyourself.com
- 2) Approve the Annual Performance Plan Quote and return to GFY
- 3) GFY will contact you to schedule your Performance Plan
- 4) Check it OFF your To-Do list
- 5) Peace of MIND!

GFY ANNUAL PERFORMANCE PLAN CHECKLIST REQUIRED TO MAINTAIN YOUR WARRANTY

Email completed form and pictures to: info@gofanyourself.com

Company: _____
Address: City/ _____
State/Zip: _____ Contact Name: _____
Email: _____ Phone: _____

The performance plan outlined below will be completed on GFY[®] large diameter ceiling mount fans annually:

Fan(s) Number or Location: _____

- 1) Visual inspection of fan. (look for any sign of damage or unusual wear)
- 2) Check fan mounting structure and fan level and plumb.
- 3) Verify hardware connections.
- 4) Verify guy wire tension and inspect cables and connections. (if equipped, guy wires should be snug)
- 5) Inspect hub, blades and **Z-Tech**[™] leading edges. (look for any sign of damage or unusual wear)
- 6) Verify blade connection. (blade hardware to be torqued to 30 ft lbs +/- 2 ft lbs)
- 7) Check Integrity of safety system. (hardware is tight, straps show no signs of wear)
- 8) Check gearbox performance & operation including breather (if equipped). (fan should turn easily by hand in both directions - no unusual noises or interruptions of smooth travel)
- 9) Check Integrity of electrical connections. (wire discoloration often means excess heat)
- 10) Check fault log and record any reported faults. Check motor performance & operation.
- 11) Document any observations with pictures and in "Notes" below.
- 12) Clean the fan with a mild detergent and/or clean water.

Take pictures and send to GFY along with this checklist(s) of the fan from the floor and close-ups showing **Z-Tech**[™] SS properly installed at the motor/hub assembly and at the upper yoke weldment.

Notes:



GFY® Annual Performance Plan Record

Fan Location:
Fan Diameter:
Motor Serial Number:
Motor Size:

Fan Location:
Fan Diameter:
Motor Serial Number:
Motor Size:

Fan Location:
Fan Diameter:
Motor Serial Number:
Motor Size:

Fan Location:
Fan Diameter:
Motor Serial Number:
Motor Size:

Fan Location:
Fan Diameter:
Motor Serial Number:
Motor Size:

Fan Location:
Fan Diameter:
Motor Serial Number:
Motor Size:

Date	Mechanic Signature

Date	Mechanic Signature

Date	Mechanic Signature

Date	Mechanic Signature

Date	Mechanic Signature

Date	Mechanic Signature

Date	Mechanic Signature

Date	Mechanic Signature

Date	Mechanic Signature

Date	Mechanic Signature

Date	Mechanic Signature

Date	Mechanic Signature

Date	Mechanic Signature

Date	Mechanic Signature

Date	Mechanic Signature

Date	Mechanic Signature

Date	Mechanic Signature

Date	Mechanic Signature

Date	Mechanic Signature

Date	Mechanic Signature

Date	Mechanic Signature

Date	Mechanic Signature

Date	Mechanic Signature

Date	Mechanic Signature

ACS355 CONTROL TROUBLESHOOTING

Troubleshooting Tips:

- If possible, swap the VFD control with another fan to isolate the problem.

Test the VFD Control:

- Remove power at the breaker supplying the control and perform Lock Out / Tag Out procedures.
- Disconnect the output power wires running from the VFD to the Fan Motor.
- Remove LOTO and restore power to the VFD.
- Turn the VFD on and watch for the proper start up sequence.
 - "ABB" screen comes up for a few seconds.
 - Fan "home" screen comes up showing fan performance.
- Operate the VFD as if the fan were connected.
 - The VFD should work normally as the screen indicates VFD output, not fan operation.
 - If the VFD does not operate properly or faults/alarms are triggered the VFD should be replaced.

Test the Motor Housing Assembly:

- Turn the fan off at the VFD Control and perform Lock Out / Tag Out procedures.
- Turn the fan by hand in both directions. The fan should turn easily in both directions. If it does not observe:
 - Look for any mechanical interference between the blades/hub and the fan frame.
 - Feel for grinding, the movement of the fan should be smooth and quiet.
 - Listen for grinding or any metal on metal contact.
- The GFY gearmotor is a motor and gearbox. Anything that looks or sounds other than you'd expect from a motor and gearbox is a likely indication of a problem. The Motor Housing Assembly should be replaced.

- 1) Depending on the fault received they may be two different reactions from the keypad LED:
 - a) Flashing Green indicating either:
 - i) Fire Alarm signal is currently being received and preventing the fan from operating.
 - ii) Minor fault that did not require the fan to shut down but requires an operator reset.
 - 1) In this case the soft key "DIR" to reverse direction will change to "RESET".
 - a) Once "RESET" is pushed the fault will clear and the LED will return to solid green.
 - b) A record of this fault may be retrieved from the "Fault Logger".
 - b) Solid Red indicating the alarm shown on the screen caused the fan to shut down.

Alarm 2023 "Emergency Stop" is shown below. This is caused by the Fire Alarm input. The LED will be Flashing Green.

Flashing Green LED

A "Fire Alarm" activation will read "Emergency Stop" and will stay active until the input from the alarm system is removed. This screen will toggle with the Home Screen showing Hz, Amps, and % of speed all reading zero.

You can create this alarm for testing purposes by removing the jumper running from terminal position 9 to 14.

Both jumpers must be removed once the Fire Alarm connection is made.



ACS355 CONTROL TROUBLESHOOTING

To retrieve or review a Fault:

1. Press "MENU" from the home screen.



2. Once in the Main Menu arrow to "Fault Logger".

(The list will start with the last menu selected. In this case "PARAMETERS". Arrow down to "FAULT LOGGER".



3. Press "Enter" to select "FAULT LOGGER".



ACS355 CONTROL TROUBLESHOOTING

4. Review the list of faults. The list is organized with the most recent fault at the top.

Press "DETAIL" to see additional information about the fault selected.



5. Arrow up and down to see the desired information.

Hit the "DIAG" button for troubleshooting tips. These tips assume the drive and fan have been operating successfully and do not pertain to common installation faults in most cases.



6. Arrow up and down to review the diagnostic information and troubleshooting tips.

Press "Exit" to leave the diagnostic information.



ACS355 CONTROL TROUBLESHOOTING

2001 - Output current from the drive to the motor has exceeded the trip level.

- Check the integrity and connections of the motor power wires running from the drive to the fan.
- Verify drive input voltage is grounded on the "PE" terminal lug and the motor power voltage is grounded to one of the "Ground" terminal lugs.
- Spin the fan by hand. It should move freely in both directions.
 - If you cannot spin the fan by hand the motor may be seized up and must be replaced.
 - If the fan moves easy in one direction and much more difficult in the other direction the motor must be replaced.
- Motor may be nearing the end of it's useful life. All motors may draw more current as they age. This motor may be gradually failing to the point of drawing more current than the drive can supply. It must be replaced.

2002 - Input voltage has too much noise and must be conditioned in front of the drive.

- Place a commercial line reactor on the input power wires supplying the drive.
- Verify drive input voltage is grounded on the "PE" terminal lug and the motor power voltage is grounded to one of the "Ground" terminal lugs.

2003 - Input voltage trouble.

- Most common problem is a dropped phase of the 200-240 3 phase or 380-480 3 phase line voltage.

2006 - Control signal is not being received by remote drive.

- This fault message should only be possible when your application is controlling multiple drives (fans) from a single keypad. When controlling drives remotely from another keypad the signal from the controlling keypad is sent through a wired connection to the remote drive. This signal is not being received.
- Check the wire connections in the terminal blocks of the drive with the fault code and the previous drive in line.
- Check the integrity of the low voltage control wire connecting the drives.

2008 - Drive has lost communication with the keypad.

- Swap keypads with another drive to isolate the fault.
 - The keypad connector is fragile. Take care when breaking and making the connection.
- Verify keypad wire integrity.
 - Use a spare data cable to isolate if it's the cable or the output from the drive.

2026 - Input phase loss.

- Line voltage supply to the drive has dropped a phase.

See the ACS355 manual you received with your fan shipment for greater details.

ACS255 CONTROL TROUBLESHOOTING

Symptom

Troubleshooting Steps

Fan Turning Wrong Direction

For cooling (forward) operation the stepped edge of the blade should be the leading edge. When running in destratification only (reverse) mode the stepped edge of the blade should be trailing. You will feel no (or very little) airflow when the fan is running in reverse. Reverse two of the phases either at the control or at the motor to reverse fan direction.

Fan Will Not Start

- 1) Turn off the fan at the LOTO Disconnect on the face of the drive.
- 2) Wait ten seconds.
- 3) Reapply power and watch the drive go through it's normal start up sequence.
 - a) ABB shows on the screen for a few seconds.
 - b) Fan stats ("H" Hertz, "A" Amp Draw, "%" Speed)
- 4) If control boots up properly and fan will not turn remove power from the drive and turn the fan by hand in both directions. Fan should move easily in both directions.
- 5) Check power connections in all locations of the drive and motor.
- 6) Be sure input power in the drive is grounded to "PE" and output power from the drive is grounded to either of the two ground terminals next to "PE".

Fan Wobbles During Operation

Fan mounting structure is not rigid enough to support normal fan operation. Verify the fan is not being exposed to external air movement. If the fan downtube is longer than 3 FT guy wires are required to stabilize the fan. If guy wires are installed verify proper installation.

Fault Code	No.	Description	Corrective Action
SToP	0x00	Drive is READY and in a stopped condition.	The motor is not energized. No enable signal is present to start the drive.
F0001	0x03	Instantaneous Over current on the drive output. Excess load or shock load on the motor.	<p>Fault occurs immediately on drive enable or run command Check the output wiring connections to the motor and the motor for short circuits phase to phase and phase to earth.</p> <p>Fault occurs during motor starting Check the motor is free to rotate and there are no mechanical blockages.</p> <p>Fault occurs when motor operating at constant speed Investigate overload or malfunction. The motor may be nearing the end of it's useful life. All motors draw more current as they age. This motor may need to be replaced.</p>
F0004	0x05	Hardware Over Current	Check the wiring to motor and the motor for phase to phase and phase to earth short circuits. Disconnect the motor and motor cable and retest. If the drive trips with no motor connected, it must be replaced and the system fully checked and retested before a replacement unit is installed.
F0014	0x0B	External trip (on digital input 3)	ESFR Fire Relay circuit is tripped. See the Installation and Technical Specifications Guide for additional information including required programming.
F0022	0x0E	Input phase loss trip	Drive intended for use with a 3 phase supply has lost one input phase.
F0006	0x07	Under voltage on DC bus	The incoming supply voltage is too low. This trip occurs routinely when power is removed from the drive. If it occurs during running, check the incoming power supply voltage and all components in the power feed line to the drive.

See the ACS255 manual you received with your fan shipment for greater details.

ACS255 CONTROL TROUBLESHOOTING

Troubleshooting Tips:


Test the VFD Control:

- Remove power at the breaker supplying the control and perform Lock Out / Tag Out procedures.
- Disconnect the output power wires running from the VFD to the Motor.
- Remove LOTO and restore power to the VFD.
- Turn the VFD on and watch for the proper start up sequence.
- Operate the VFD as if the fan were connected.
 - The VFD should work normally as the screen indicates VFD output, not fan operation.
 - If the VFD does not operate properly or faults/alarms are triggered the VFD should be replaced.

Test the Motor Housing Assembly:

- Turn the fan off at the VFD Control and perform Lock Out / Tag Out procedures.
- Turn the fan by hand in both directions. The fan should turn easily in both directions. If it does not observe:
 - Look for any mechanical interference between the blades/hub and the fan frame.
 - Feel for grinding, the movement of the fan should be smooth and quiet.
 - Listen for grinding or any metal on metal contact.
- The GFY gearmotor is a motor and gearbox. Anything that looks or sounds other than you'd expect from a motor and gearbox is a likely indication of a problem. The Motor Housing Assembly should be replaced.

The image below shows a control during normal fan operation.

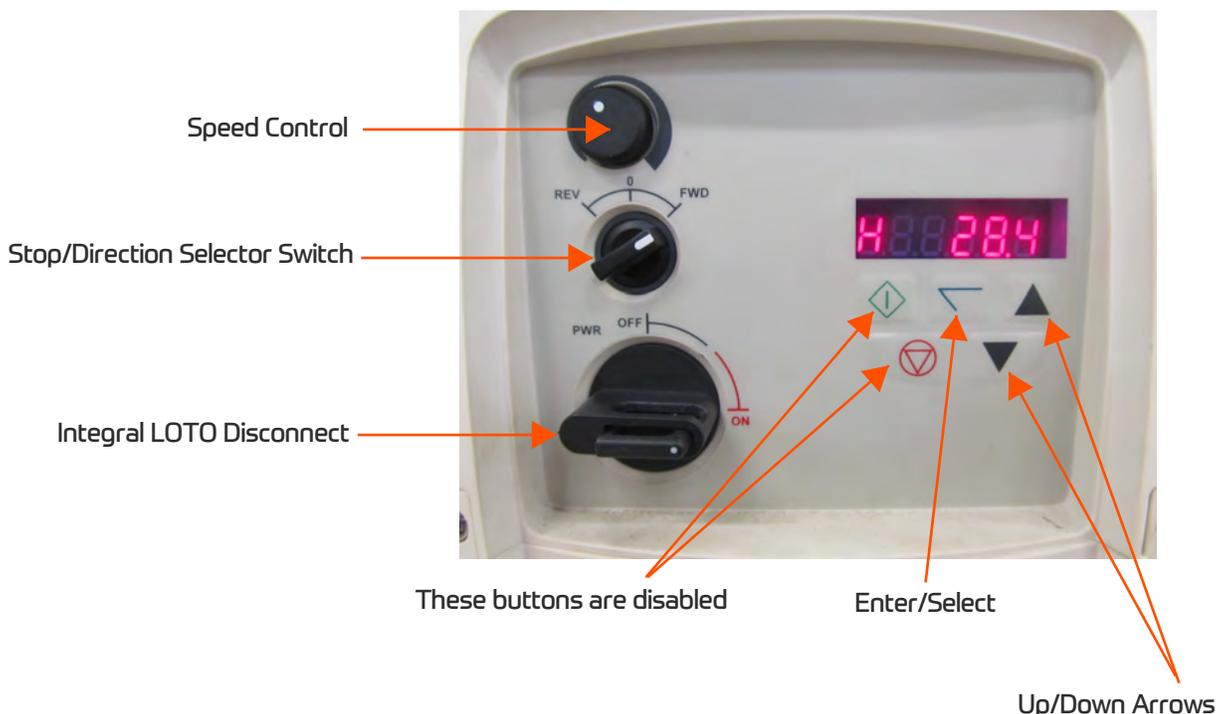

ACS255 CONTROL TROUBLESHOOTING

1. Press "Enter" and hold for 1 second until the "Parameters" screen appears. "PAr L" or "PAr S" will be displayed.
2. To observe the last recorded fault enter the "long" parameter list.
3. Use the arrows to toggle between the long and short parameter list.

PAr L = Long Parameter List

PAr S = Short Parameter List

See ACS255 Manual for Greater Detail



4. Default parameter setting shown. Press the up arrow to move to parameter set 0401.



5. Parameter set 0401 details the last fault recorded by the drive. The ACS255 only records the last fault created.
6. Press "Enter" to see the last fault.



Last recorded fault displayed.

Press "Enter" for longer than 1 second to return to the home screen.



Limitation of Warranties and Liabilities Fifteen Year Limited/Pro-Rated Warranty

GFY® Z-Tech™ Fans are of industrial grade construction and should provide many years of service provided routine maintenance is completed as scheduled. Warranty duration is as follows:

a)	Z-Tech™ Blade	Lifetime Warranty
b)	Aluminum Alloy Hub	Lifetime Warranty
c)	Motor	15-year Limited Warranty with Factory Certified Installation 8-year Limited Warranty with Non-Factory Certified Installation
d)	Gear Reducer	15-year Limited Warranty with Factory Certified Installation 8-year Limited Warranty with Non-Factory Certified Installation
e)	VFD Control Panel	15-year Limited Warranty with Factory Certified Installation 8-year Limited Warranty with Non-Factory Certified Installation
f)	Z-Chill™ Vent/Louver Assembly Z-Chill™	Lifetime Warranty
g)	HVAC Components	No GFY® Warranty Coverage. These Component Warranties are per the Manufacturer and supported by the Installing Contractor.
h)	Labor	1 year Limited Warranty for Factory Certified Installation Only (requires pre-authorization from GFY®)
i)	Custom fan wraps/paint	1 year Limited Warranty

Go Fan Yourself® warrants that this product will, under normal use and service as specified by Go Fan Yourself®, operate properly and be free of defects in materials and workmanship for a period of three years from the date of purchase by customer. The term “operate properly” in this context applies to mechanical, electrical and structural functions only. No guarantee, unless and except by separate written agreement, is made regarding dimensions of air movement generated or the effectiveness of this product for its intended purpose.

Labor warranty will cover all reasonable costs paid by the customer to an independent contractor (including dealers) to remove, dismantle, reassemble or reinstall any of the warranted Products during the first year that the Product is in service. All receipts are to be submitted to Go Fan Yourself® which will be paid upon completion of the installation of the Product and after the return of the failed unit. Go Fan Yourself® will only issue a credit/check to the customer/dealer and will not be held responsible for paying the independent contractor.

Warranty Exclusions

Please note that the following may or could void any or all of the above listed warranties.

- Not following required installation procedures as in installation guide and all other documentation supplied with the fans and related equipment supplied by manufacturers of individual fan and control components.
- Not following all relevant codes and ordinances, not limited to National Electrical Code, provincial, or state and local building codes.
- Not following electrical engineering industry standards regarding approved method of installing solid-state electrical equipment having characteristics of fans and all components included in this product.
- Any modification to installation, product, controls without written authorization from Go Fan Yourself®, even if attempting to diagnose and/or repair a problem.
- Misuse, abuse, accidents, unreasonable use, or Acts of God.
- Incorrect electrical current, voltage or supply.
- Running fans at higher than recommended speeds.
- Re-setting parameters of any control without prior approval from Go Fan Yourself.®
- Failure to use all installation and mounting hardware supplied by Go Fan Yourself.®
- Failure to perform periodic maintenance as detailed in the Z-Tech™ Fan Installation Guide.

Limitation of Warranties and Liabilities Fifteen Year Limited Pro-Rated Warranty

Go Fan Yourself® reserves the right to make the final determination, based on its own evaluation of the components as to whether:

- The problem in question is the result of a defect in design, workmanship or materials and not the result of error, misuse or abuse on the part of the customer as stated above.
- Whether the problem or defect is material and requires action under this warranty.
- Whether the remedy of repair or replacement is appropriate.

Go Fan Yourself® will not be responsible for remedial work necessary to correct installation procedures that do not conform to those established by the instructions, codes and standards, regardless of when the installation occurred.

With regard to electrical and electronic components provided by Go Fan Yourself® that comprise part of the products, including motors, motor drives and variable frequency drives, Go Fan Yourself® relies on the determination by the original manufacturer as to whether the failure of such components was the result of a defect. If the manufacturer of such components determines that there was no defect and therefore refuses to cover it under warranty, Go Fan Yourself® likewise will not warranty such item unless Go Fan Yourself® determines that the failure of such electrical or electronic component was the result of a defect of design, workmanship or material within some other part of the products.

Warranty Duration

With respect to replacement or repair rendered, Go Fan Yourself® warrants that the parts replaced or repaired will operate properly and be free from defects in materials and workmanship for a period of 90 days from the shipment date of the replacement products to the customer or for the remainder of the original warranty period, whichever is longer.

Warranty Claim Instructions

1. Contact your original dealer/salesman of the purchase when you first notice problem with the product.
2. It will be the responsibility of the dealer or salesman to assist the customer in determining what product is causing the problem.
3. If they cannot diagnose the problem, they are to contact Go Fan Yourself® with all the necessary information.
4. The appropriate department will then be in contact with the customer to determine the cause of the problem.
5. Once diagnosed, attain pre-authorization from Go Fan Yourself® for any costs covered by the 1 year labor warranty.
6. Submit a Purchase Order for a replacement unit complete with price.
7. A replacement unit will be shipped out upon receipt of the PO. This PO allows for an order to be established in the Go Fan Yourself® system.
8. Once the units have been changed over, submit all pre-authorized costs to Go Fan Yourself® for payment.
9. No credits or checks will be issued until all original products are received back at Go Fan Yourself® and warranty statue can be verified or unless Go Fan Yourself® directs otherwise.

Limitation of Warranties and Liabilities Fifteen Year Service Life Pro-Rated Warranty

WARRANTOR: The warrantor for the limited warranties set forth herein is Go Fan Yourself® (“Company”).

LIMITED WARRANTY: This prorated limited warranty (this “Warranty”) applies only to the original End-User (the “End-User”) of any Go Fan Yourself® Z-Tech™ Ceiling Fan(s) (Individually and collectively, the “Product”) and cannot be transferred. This Warranty applies even in the event that the Product is initially sold by Company for resale to End-User. This Warranty applies to U.S. and Canada purchases only. Outside U.S. and Canada; standard Three-Year Warranty applies.

WHAT THIS WARRANTY COVERS: In addition to the Lifetime Warranty on blades, hub and frame; and the standard Three-Year Limited Warranty covering all other components, the Warrantor warrants that the product will have a service life (defined below) of Fifteen Years from the date of purchase (the “Fifteen Year Service Life”) when used in accordance with the operation and maintenance procedures prescribed in the Go Fan Yourself® Installation Manuals.

If Company finds, in its sole discretion, that any Product has not provided the Fifteen-Year Service Life, Company will, as its sole obligation and the End-User’s sole remedy for Company’s breach of this Warranty, repair or replace the Product, at its option, F.O.B. Company’s factory, for a charge, payable to Company prorated on the following basis:

The End-User will be allowed a credit against Company’s list price of equivalent equipment at the time of return of the Product to Company, in proportion to the percentage of Fifteen-Year Service Life remaining at the time of return of the Product to the Company. The End-User will assume responsibility to pay the balance of the list price; and Company reserves the right to require payment prior to delivery of the repaired or replacement equipment.

For the avoidance of doubt, Company’s responsibilities under this 15-year Warranty are as follows:

- Year 1-3 - Product repaired or replaced pursuant to terms if Limited Warranty applies.
- Year 4-5 - Product purchased at 40% off list price per current Service Parts Price List.
- Year 6-10 - Product purchased at 25% off list price per current Service Parts Price List.
- Year 11-15 - Product purchased at 10% off list price per current Service Parts Price List.

Company’s responsibilities under this 8-year Warranty covering non-factory certified installations are as follows:

- Year 1-3 - Product repaired or replaced pursuant to terms if Limited Warranty applies.
- Year 4-5 - Product purchased at 35% off list price per current Service Parts Price List.
- Year 6-8 - Product purchased at 20% off list price per current Service Parts Price List.

WHAT THIS WARRANTY DOES NOT COVER

-any defects or damages caused by:

- (a) failure to properly store the Product before installation;
 - (b) shipping and delivery of the Product if shipping is FOB Factory;
 - (c) neglect, accident, abuse, misuse, misapplication, incorrect installation, installation in any caustic/harsh environment including direct sunlight for extended periods;
 - (d) repair or alteration not authorized in writing by Go Fan Yourself® personnel;
 - (e) improper testing, operation, maintenance, adjustment, or modification of any kind not authorized in writing by Go Fan Yourself® personnel;
- OR
- (f) use the Product under operating conditions outside unit specifications or in a manner inconsistent with the product’s label or instructions.
 - controls and/or any other external electronic controlling devices.
 - exclusions listed in the standard Three-Year Limited Warranty.
 - any products or components purchased prior to effective date of this Warranty.

Limitation of Warranties and Liabilities Fifteen Year Service Life Pro-Rated Warranty

This warranty is not valid

- (a) if the Product's serial numbers have been removed or are illegible; OR
- (b) if any warranted items repaired or replaced pursuant to this Warranty will be warranted for the remaining portion of the original Warranty subject to all the terms thereof. Company shall not be responsible for any charges for testing, checking, removal or installation of warranted items unless authorized in writing by Company personnel; OR
- (c) if failed to submit records at time of performing Recommended Maintenance Schedule per the Installation and Technical Operations Guide.

LIMITATION OF LIABILITY: The remedies of the End-User set forth herein are exclusive and are the sole remedies for any failure of Company to comply with its obligations hereunder. In no event shall Company be liable in contract, in tort (including negligence or strict liability) or otherwise for damage to property or equipment other than the Products, including loss of profits or revenue, loss of use of Products, cost of capital, claims of customers of the End-User or any special, indirect, incidental or consequential damages whatsoever. The total cumulative liability of Company hereunder whether the claims are based in contract (including indemnity), in tort (including negligence or strict liability) or otherwise, shall not exceed the price of the Product on which such liability is based. Company shall not be responsible for failure to provide service parts due to causes beyond Company's reasonable control. "Lifetime" is defined as a period ending three (3) years after Go Fan Yourself® discontinues manufacturing the product, as such period is defined by Go Fan Yourself®, but in no event shall this period be less than the one year from the date that the Warranty Period commences.

END-USER'S OBLIGATIONS: In order to receive the benefits of this Warranty, the End-User must use the Product in a normal way; follow the Product's Installation Manuals; and protect against further damage to the Product if there is a covered defect. Submit records at time of performing Recommended Maintenance Schedule per the Installation and Technical Operations Guide.

OTHER LIMITATIONS: Company's obligations under this Warranty are expressly conditioned upon receipt by Company of all payments due to it, including all applicable interest charges. During such time as Company has not received payment of any amount due to it for the Product, in accordance with the contract terms under which the Product is sold, Company shall have no obligation under this Warranty. Also during such time, the period of this Warranty shall continue to run and the expiration of this Warranty shall not be extended upon payment of any overdue or unpaid amounts.

COSTS NOT RELATED TO WARRANTY: The End-User shall be invoiced for, and shall pay for, all services not expressly provided for by the terms of Warranty, including without limitation, site calls involving an inspection that determines no corrective maintenance is required. Any costs for replacement equipment, installation, materials, freight charges, travel expenses or labor of Company representatives outside the terms of this Warranty will be borne by the End-User.

OBTAIN WARRANTY SERVICE: Call Go Fan Yourself,® Service 1-847-648-4920. Company will not accept any product for return, credit or exchange unless expressly authorized by Company in writing and delivered FOB Company factory with proper Return Authorization Number attached to the product.

Any and all parts of this guide are subject to change without notification.